



# Essex Asbestos Testing Ltd

15 Lampits Lane, Corringham, Essex, SS17 9AD. Tel: 01375 643863 or 07967 118686

E-mail: [info@essex-asbestos-testing.co.uk](mailto:info@essex-asbestos-testing.co.uk) Web: [www.essex-asbestos-testing.co.uk](http://www.essex-asbestos-testing.co.uk)



8007

## AIRBORNE FIBRE COUNT CERTIFICATE

Report No: F/23/1235

Date on Site: 21.08.2023

Time on site: 0700 hours

Technician: Ian Elder

Client name and address: Horizon Environmental Ltd, Ovendon House, Willcox Close, Aylesham, Kent CT3 3EP  
Contact name: C. Smith

Contractor's name and address: Horizon Environmental Ltd, Ovendon House, Willcox Close, Aylesham, Kent CT3 3EP  
Site supervisor: Gary Nethercot

Site address: Former Holloway Prison, Parkhurst Road, London. N7 0NU

Location on site: Road C area

Brief description of work being carried out: Removal of soil and rubble to expose ACMs

Description of testing to be carried out: Far Source Testing


Comments: All air test results were satisfactory.

**Opinions and interpretations contained in this report are clearly marked and are outside the scope of Essex Asbestos Testing's UKAS accreditation.**

### Diagram of area tested

Diagram to include approximate dimensions and sample locations

Approximate floor area = (m<sup>2</sup>) Drawing is not to scale Approximate volume = (m<sup>3</sup>)

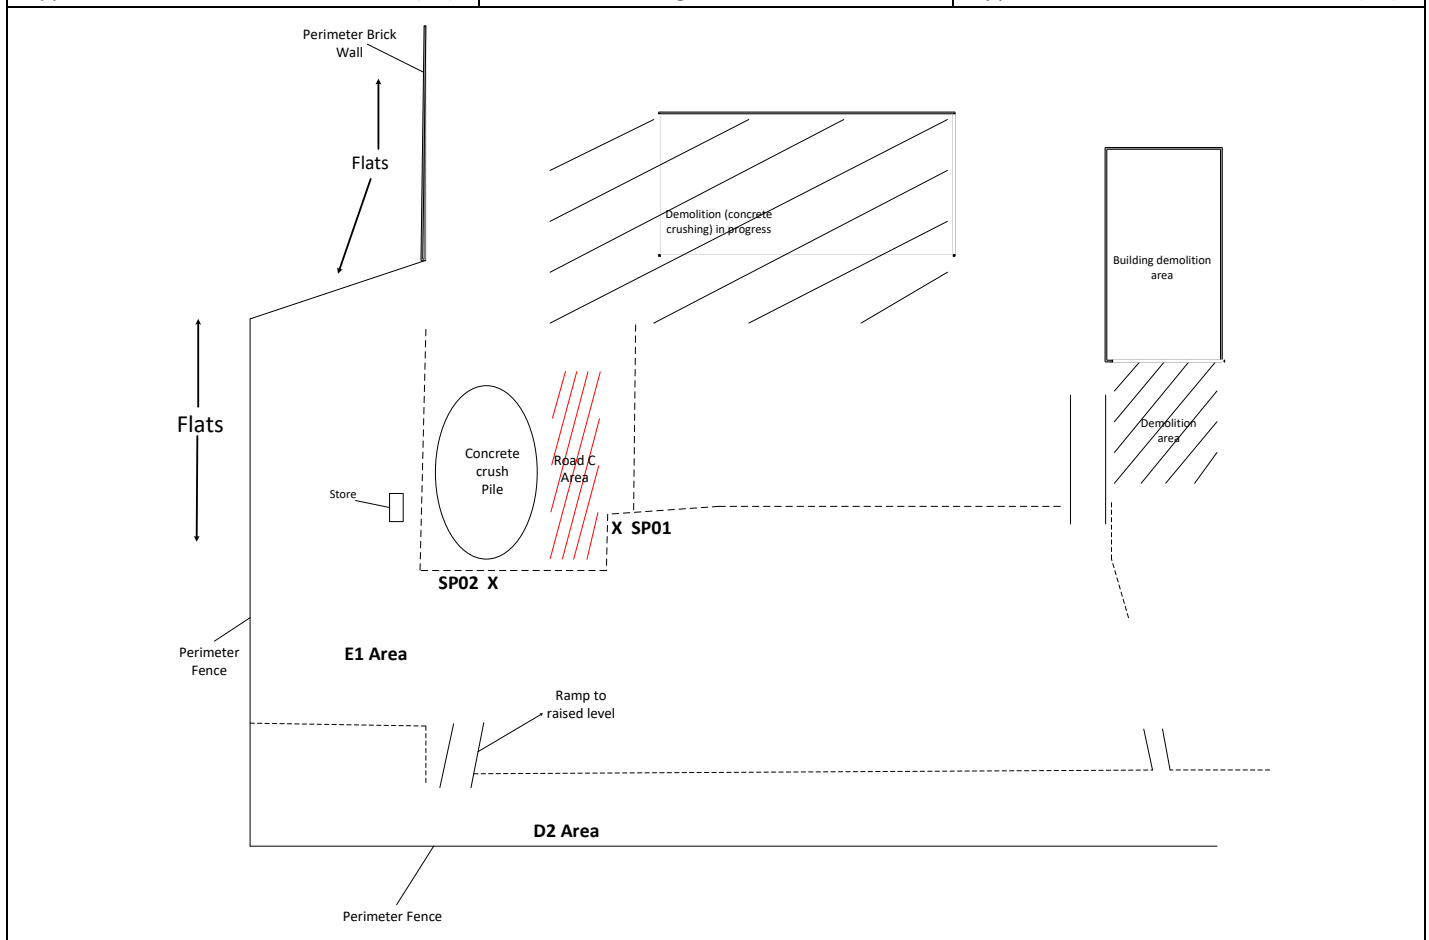

**AIRBORNE FIBRE COUNT CERTIFICATE**

Technical details					
Microscope No:	MIC4	Filter batch No:	409	Low Flow meter No:	LFM5
Phase Telescope No:	PT2	Microscope set up:	Yes	High Flow meter No:	MF5
N.P.L. Test slide No:	NPL4	No of N.P.L. blocks visible:	5	Flow rate correction required:	No
Stage Micrometer No:	SM4	Graticule diameter (µm):	101	Exposed filter measurement (mm²):	394.48
Bar/Ther/Time piece No:	BTT4	Lab type:	Mobile	Reg No.	YH68 HMJ

Type of test:     **(B) Background,**     **(L) Leak,**     **(N) Near Source Sampling**     **(R) Reassurance,**     **(F) Far Source/perimeter Sampling**     **(WA) Work area,**     **(FB) Field Blank**


Sample Number	Technician's Sampler	Initials Analyst	Pump No.	Cowl No.	Test Type	Start Time	Finish Time	Duration (mins)	Flow rate (l/min)			Volume (litres)
									Start	Finish	Average	
S001	IE	IE	HFP 70	B1	F	0814	1003	109	8.0	8.0	8.0	872
S002	IE	IE	HFP 71	B2	F	0815	1004	109	8.0	8.0	8.0	872
S003	IE	---	---	BFB	FB	---	---	---	---	---	---	---
S004	IE	IE	HFP 70	B3	F	1003	1120	77	8.0	8.0	8.0	616
S005	IE	IE	HFP 71	B4	F	1004	1121	77	8.0	8.0	8.0	616
						END						

Sample Number	Sample Location (Refer to diagram)	No of fibres counted	No of fields counted	No of fields rejected	Calculated result (f/ml)	* Limit of quantification (f/ml)	Reported result (f/ml)
S001	SP01	2	220	0	0.001	0.005	< 0.005
S002	SP02	3	220	0	0.001	0.005	< 0.005
S003	Field Blank	---	---	---	---	---	---
S004	SP01	2	312	0	0.001	0.005	< 0.005
S005	SP02	1	312	0	0.001	0.005	< 0.005
		END					

We hereby declare that all sampling and analysis was carried out in accordance with HSE Guidance note HSG 248: The Analyst Guide and Essex Asbestos Testing Ltd in-house procedures. Any deviations from this are recorded within this certificate.

**Note. \*Uncertainty of measurement.**

The lower limit of quantification for the above method is stated in HSG 248 as about 0.01 f/ml, when sample volumes ≥ 480 litres of air are collected and 200 graticule areas examined, a calculated result below the limit may be expressed as <0.01 f/ml. For sample volumes < 480 litres and/or <200 graticule areas examined the lower limit of quantification will be higher. The reported result is for respirable fibres only.

Issued by (Print Name): Ian Elder	Signature: 	Date: 21.08.2023
-----------------------------------	--	------------------