



Essex Asbestos Testing Ltd

15 Lampits Lane, Corringham, Essex, SS17 9AD. Tel: 01375 643863 or 07967 118686

E-mail: info@essex-asbestos-testing.co.uk Web: www.essex-asbestos-testing.co.uk



8007

AIRBORNE FIBRE COUNT CERTIFICATE

Report No: F/23/1270

Date on Site: 13.09.2023

Time on site: 07.00 hours

Technician: I Donaldson

Client name and address: Horizon Environmental Ltd, Ovendon House, Willcox Close, Aylesham, Kent CT3 3EP
Contact name: C Smith

Contractor's name and address: Horizon Environmental Ltd, Ovendon House, Willcox Close, Aylesham, Kent CT3 3EP
Site supervisor: M Holder

Site address: Former Holloway Prison, Parkhurst Road, London. N7 0NU

Location on site: Area Former Boiler House

Brief description of work being carried out: Moving Crushed concrete


Description of testing to be carried out: Far Source Test

Comments: Air Test Result Satisfactory
Opinions and interpretations contained in this report are clearly marked and are outside the scope of Essex Asbestos Testing's UKAS accreditation.

Diagram of area tested

Diagram to include approximate dimensions and sample locations

Approximate floor area = N/A (m²) Drawing is not to scale Approximate volume = N/A (m³)

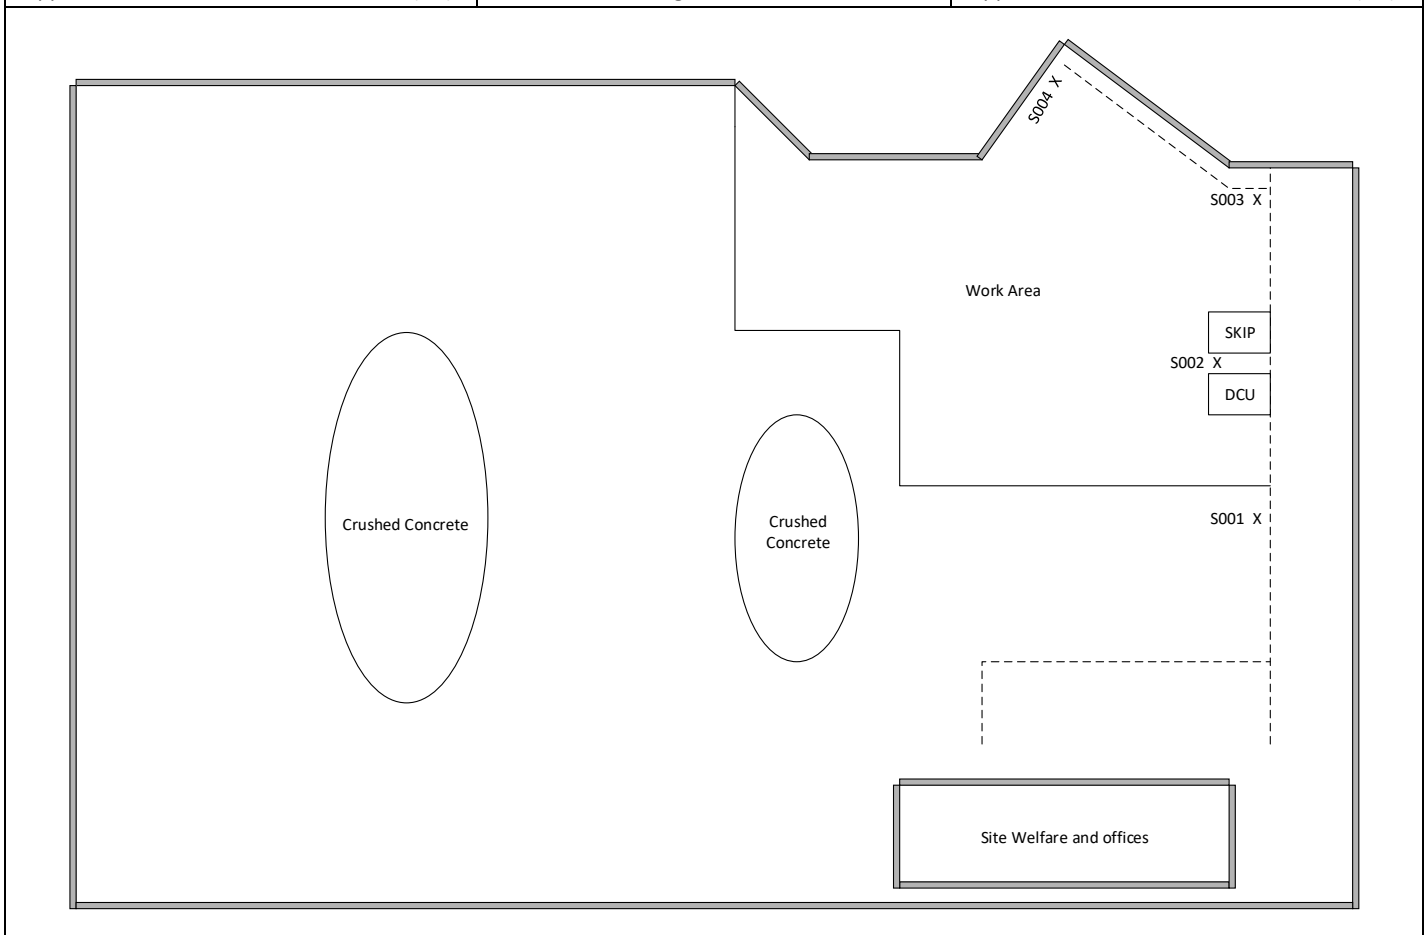

AIRBORNE FIBRE COUNT CERTIFICATE

Technical details					
Microscope No:	MIC1	Filter batch No:	410	Low Flow meter No:	LFM1
Phase Telescope No:	PT1	Microscope set up:	Yes	High Flow meter No:	MFM1
N.P.L. Test slide No:	NPL1	No of N.P.L. blocks visible:	5	Flow rate correction required:	No
Stage Micrometer No:	SM1	Graticule diameter (µm):	101	Exposed filter measurement (mm²):	394.48
Bar/Ther/Time piece No:	BTT1	Lab type:	Mobile	Reg No.	EF70CUW


Type of test: **(B) Background,** **(L) Leak,** **(N) Near Source Sampling** **(R) Reassurance,** **(F) Far Source/perimeter Sampling** **(WA) Work area,** **(FB) Field Blank**

Sample Number	Technician's		Pump No.	Cowl No.	Test Type	Start Time	Finish Time	Duration (mins)	Flow rate (l/min)			Volume (litres)
	Sampler	Initials Analyst							Start	Finish	Average	
S001	ID	ID	HFP 44	A1	F	09.10	11.32	142	8.0	8.0	8.0	1136
S002	ID	ID	HFP 45	A2	F	09.12	11.34	142	8.0	8.0	8.0	1136
S003	ID	ID	HFP 46	A3	F	09.13	11.36	143	8.0	8.0	8.0	1142
S004	ID	ID	HFP 47	A4	F	09.15	11.38	143	8.0	8.0	8.0	1142
S005	ID	ID		AFB	FB	-	-	-	-	-	-	-
S006	ID	ID	HFP 48	A5	F	11.33	13.56	143	8.0	8.0	8.0	1142
S007	ID	ID	HFP 49	A6	F	11.35	13.58	143	8.0	8.0	8.0	1142
S008	ID	ID	HFP 51	A7	F	11.40	14.00	140	8.0	8.0	8.0	1120
S009	ID	ID	HFP 52	A8	F	11.42	14.01	140	8.0	8.0	8.0	1120
						END						

Sample Number	Sample Location (Refer to diagram)	No of fibres counted	No of fields counted	No of fields rejected	Calculated result (f/ml)	* Limit of quantification (f/ml)	Reported result (f/ml)
S001	@ S001 X	2	169	0	0.001	0.005	<0.005
S002	@ S002 X	1.5	169	0	0.001	0.005	<0.005
S003	@ S003 X	2.5	168	0	0.001	0.005	<0.005
S004	@ S004 X	3	168	0	0.001	0.005	<0.005
S005	Field Blank	-	-	-	-	-	-
S006	@ S006 X	3.5	168	0	0.001	0.005	<0.005
S007	@ S007 X	2	168	0	0.001	0.005	<0.005
S008	@ S008 X	2	171	0	0.001	0.005	<0.005
S009	@ S009 X	2	171	0	0.001	0.005	<0.005
		END					

We hereby declare that all sampling and analysis was carried out in accordance with HSE Guidance note HSG 248: The Analyst Guide and Essex Asbestos Testing Ltd in-house procedures. Any deviations from this are recorded within this certificate.

Note. *Uncertainty of measurement.
 The lower limit of quantification for the above method is stated in HSG 248 as about 0.01 f/ml, when sample volumes ≥ 480 litres of air are collected and 200 graticule areas examined, a calculated result below the limit may be expressed as <0.01 f/ml. For sample volumes < 480 litres and/or <200 graticule areas examined the lower limit of quantification will be higher. The reported result is for respirable fibres only.

Issued by (Print Name): Ian Donaldson Signature:  Date: 13.09.2023