



Essex Asbestos Testing Ltd

15 Lampits Lane, Corringham, Essex, SS17 9AD. Tel: 01375 643863 or 07967 118686

E-mail: info@essex-asbestos-testing.co.uk Web: www.essex-asbestos-testing.co.uk



8007

PERSONAL MONITORING CERTIFICATE

Report No: F/23/1276-1

Date on Site: 20.09.2023

Time on site: 07.00 hours

Technician: Ian Donaldson

Contractor's name and address: Horizon Environmental Ltd, Ovendon House, Willcox Close, Aylesham, Kent CT3 3EP
Site supervisor: M Holder

Site address: Former Holloway Prison, Parkhurst Road, London, N7 ONU

Location on site: Middle of Site

Type and extent of work being carried out: Watching brief. Handing picking acm's from surface of soil

Type of RPE worn: Half Mask

Type of ACM worked with : Cement and AIB

Application (Personal Sampling)	Sampling Rate (L/min)	Minimum volume of air to be sampled (litres)	Minimum number of graticule areas to be examined	Calculated airborne fibre concentration at the limit of quantification	Mark 'X' in applicable box
4 Hour control limit	1-2	240	100	0.04	X
10 Minute short term exposure limit	4	40	100	0.24	
Assessment of suitability of RPE	0.2-4	40	100	0.24	
Specific short-duration activities	2-4	120	100	0.08	

General control measures in use (Mark 'X' in applicable box)

Enclosure under negative pressure Partial enclosure Work area only (no enclosure)

Activity record for personal sampling period

Insert actual work activities and methods of removal witnessed. Include details of how the ACM is fixed (eg. if AIB, is it screwed / nailed to timber structure and is there a void to rear), approximate size, surface treatment (eg. if painted). Include details of the specific dust suppression and control measures employed. Provide relevant photos when requested by customer. (Mark with 'X' in applicable dust suppression method employed boxes)

1	Hand Pick of ACM's 240 minutes										
Dust suppression method employed:	Injection	<input type="checkbox"/>	Spraying	<input checked="" type="checkbox"/>	Gel/Foam	<input type="checkbox"/>	Shadow vacuum	<input type="checkbox"/>	Other	<input type="checkbox"/>	<input type="checkbox"/>
2											
Dust suppression method employed:	Injection	<input type="checkbox"/>	Spraying	<input type="checkbox"/>	Gel/Foam	<input type="checkbox"/>	Shadow vacuum	<input type="checkbox"/>	Other	<input type="checkbox"/>	<input type="checkbox"/>
3											
Dust suppression method employed:	Injection	<input type="checkbox"/>	Spraying	<input type="checkbox"/>	Gel/Foam	<input type="checkbox"/>	Shadow vacuum	<input type="checkbox"/>	Other	<input type="checkbox"/>	<input type="checkbox"/>
4											
Dust suppression method employed:	Injection	<input type="checkbox"/>	Spraying	<input type="checkbox"/>	Gel/Foam	<input type="checkbox"/>	Shadow vacuum	<input type="checkbox"/>	Other	<input type="checkbox"/>	<input type="checkbox"/>

Activity	A Fibre concentration (f/ml) (Reported result)	B Sampling duration (expressed in hours)	C (A x B)
1	0.04	4	0.16
2			
3			
4			
Sum total		4	0.16

Result expressed as time weighted average (TWA) = Sum total of C ÷ Sum total of B

0.04

PERSONAL MONITORING CERTIFICATE

Technical Details					
Microscope No:	MIC1	Filter batch No:	412	Low flow meter No:	LFM1
Phase telescope No:	PT1	Microscope set-up:	Yes	High flow meter No:	MFM1
NPL test slide No:	NPL1	Number of NPL blocks visible:	5	Flow rate correction required:	No
Stage micrometer No:	SM1	Graticule diameter (µm):	101	Exposed filter measurement (mm²):	394.48
Bar/Ther/Timepiece No:	BTT1	Lab type:	Mobile	Reg No:	EF70CUW

Activity Number	Sample Number	Sampler Initials	Analyst	Pump No.	Cowl No.	Start Time	Finish Time	Duration (mins)	Flow Rate (l/min)						Volume Litres
									Start	60	120	180	240	Finish	
1	S001	ID	ID	LFP22	P1	08.20	12.20	240	1.0	1.0	1.0	1.0	1.0	1.0	240
							END								


Activity number	Sample number	Name of person / Job title	No of fibres counted	No of fields counted	No of fields rejected	Calculated result f/ml	* Limit of quantification f/ml	Reported result f/ml
1	S001	G Nethercott (operative)	1.5	100	0	0.003	0.04	<0.04
			END					

We hereby declare that all sampling and analysis was carried out in accordance with HSE Guidance note HSG 248: The Analyst Guide and Essex Asbestos Testing Ltd in-house procedures. Any deviations from this are recorded within this certificate.

Note. *Uncertainty of measurement.


The lower limit of quantification for the above method is stated in HSG 248 as about 0.01 f/ml, when sample volumes ≥ 480 litres of air are collected and 200 graticule areas examined, a calculated result below the limit may be expressed as <0.01 f/ml. For sample volumes < 480 litres and/or <200 graticule areas examined the lower limit of quantification will be higher. The reported result is for respirable fibres only.

Layout diagram of work location						
Approximate floor area =	N/A	(m²)	Drawing is not to scale	Approximate volume =	N/A	(m³)

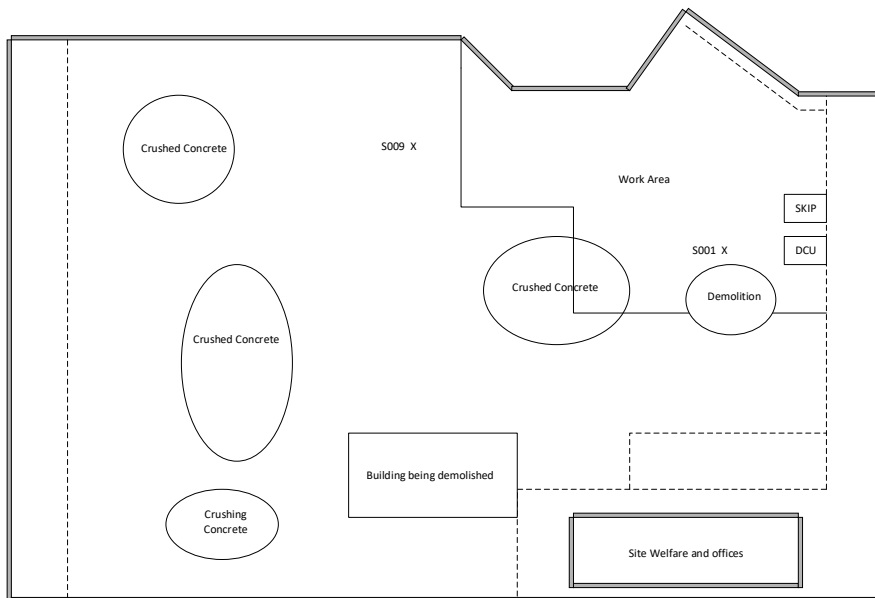

Comments:

Opinions and interpretations contained in this report are clearly marked and are outside the scope of Essex Asbestos Testing's UKAS accreditation

Issued by (Print Name): I Donaldson Signature:  Date: 20.09.2023