

Holloway Park, London

Construction Monitoring Report

Client: London Square
Ref: CM113-22405-R0
Date: 15 August 2025
Note by: Anthony Coraci, MSc DipIOA MIOA, Senior Acoustics Consultant

1. INTRODUCTION

- 1.1 This Technical Note sets out results of the construction monitoring being carried out at the above site between Monday 28th July & Saturday 9th August 2025. The monitoring is being carried out in general agreement with the methodology in the current Section 61 Consent between the London Borough of Islington and London Square.

2. SITE ACTIVITIES

- 2.1 The following activities have been carried during the period covered by this report, in addition to the usual use of the Haul Road with site vehicles, and mobile plant used around the site:


- Block C1 – work on the roof parapet walls. Striking work to continue. Bricklayers working on the internal floors at ground level. Scaffolding work ongoing.
- Block C2 – work on the roof upstands taking place, scheduled to finish by Friday 15th August. Striking work to continue. Bricklayers working on the internal floors at ground level.
- Block D1 – window installation ongoing at ground floor level.
- D2 – Setup of the hoist ongoing.
- Blocks D1 & D2 – Scaffolding work, waterproofing and bricklaying works taking place.
- Groundwork team working on the water pipe installation between Blocks E1 & E2, which is in close proximity of Monitoring Location 2. This work includes trench excavation.

3. MONITORING DATA

3.1 This section sets out a summary of the monitoring data that has been recorded onsite and provides a discussion of any exceedances and best practicable means incorporated by the site team if exceedances were believed to be construction related.

Dust Monitoring Results

Location 1 (meter ref. TNO4728)

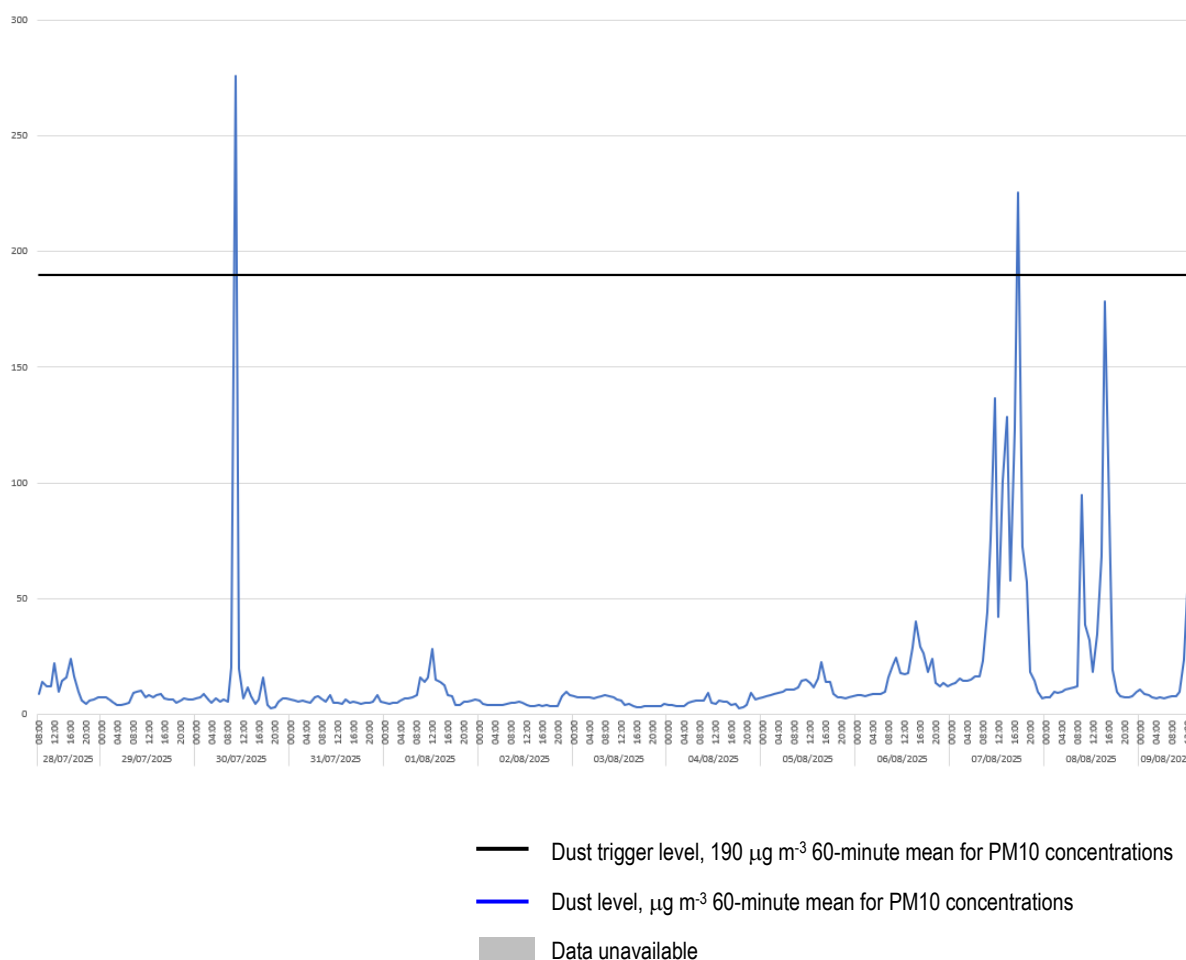


3.2 There was 100% data coverage during the monitoring period. There were two exceedances of the dust trigger of 190 $\mu\text{g m}^{-3}$ recorded at this location during construction hours. These occurred on:

- Wednesday 30th July, at 10:00, with a measured level of 275.9 $\mu\text{g m}^{-3}$; and,
- Thursday 7th August, at 17:00, with a measured level of 225.7 $\mu\text{g m}^{-3}$.


- 3.3 Based on discussions with site management, this was understood to have been caused by work taking place at Block C, including striking work. The current warm, dry weather conditions are likely to have contributed to the spread of dust across the site. It is recommended that site management continue regular water suppression across relevant areas to minimise the risk of further exceedances.

Location 2 (meter ref. TNO4778)

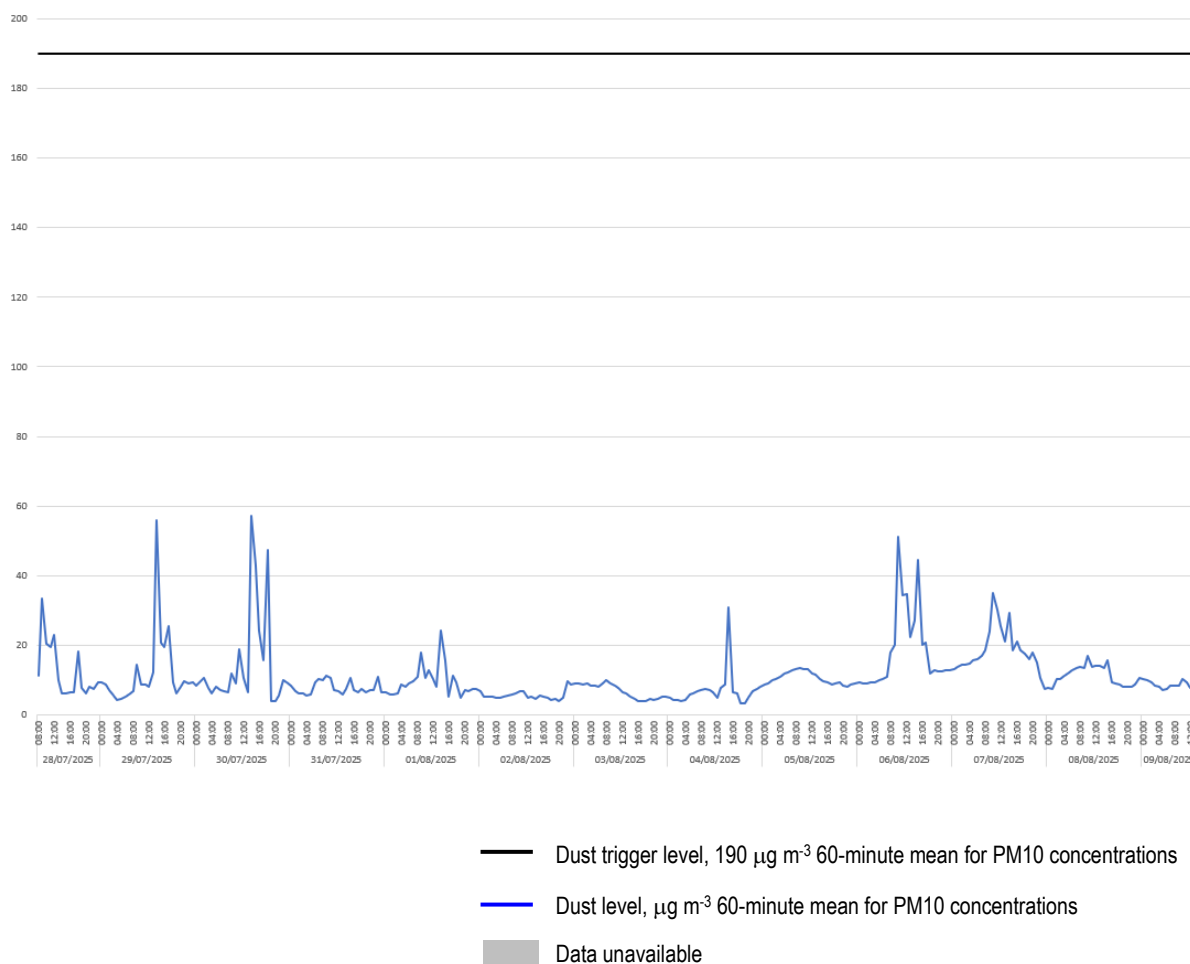

- 3.4 There was 100% data coverage during the monitoring period covered by this report. There were no exceedances of the dust trigger of 190 $\mu\text{g m}^{-3}$ recorded at this location during construction hours.

Location 3 (meter ref. TNO4729)

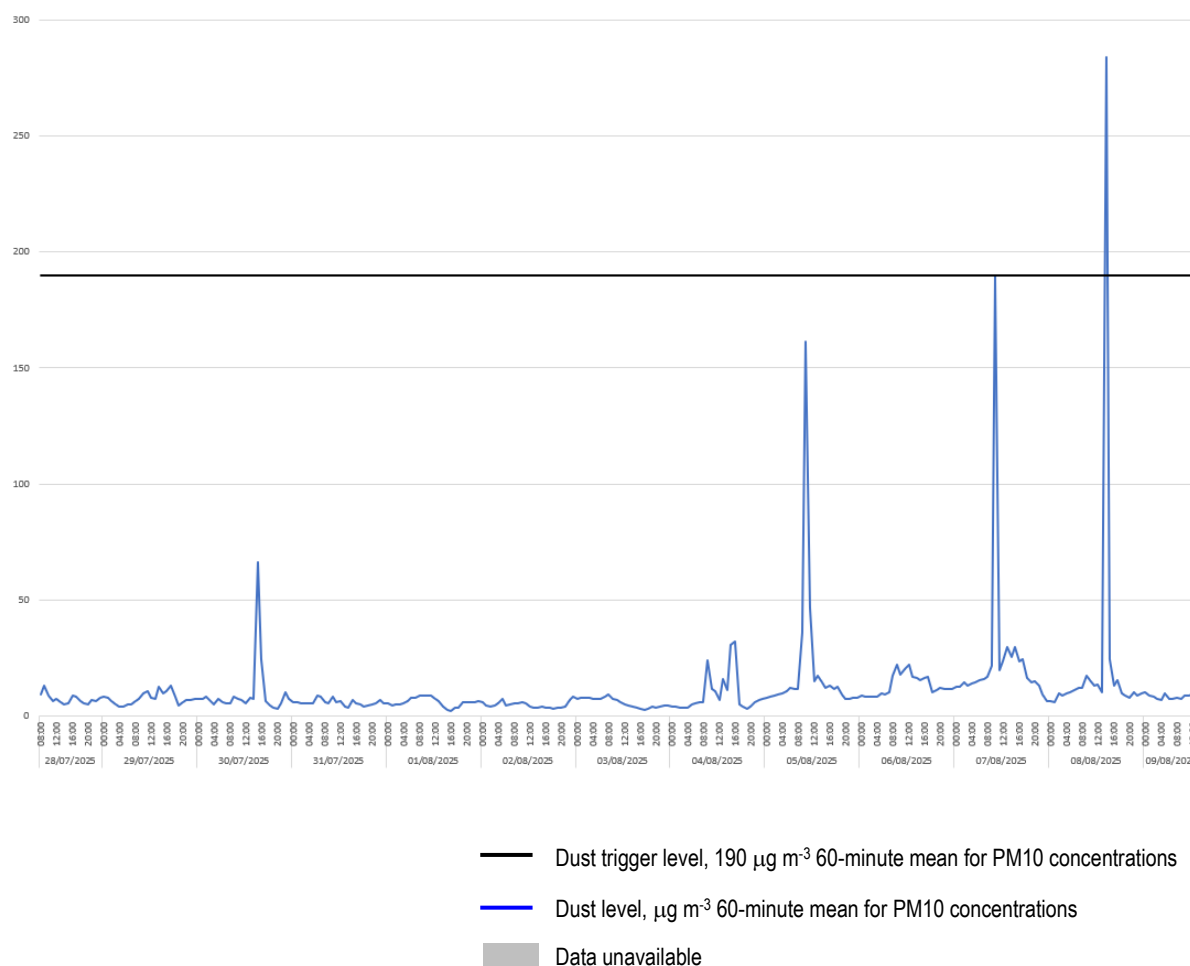


- 3.5 There was 100% data coverage at Location 3 during construction hours for the monitoring period covered by this report. One exceedance of the project dust trigger level of 190 $\mu\text{g m}^{-3}$ was recorded at this location during the monitoring period covered by this report. This occurred at 14:00 on Friday 8th August, with a measured level of 284.2 $\mu\text{g m}^{-3}$. Based on discussions with site management, this is likely to have been caused by parking bay formation work taking place within the vicinity of the monitoring location. This will continue to be monitored.

Noise Monitoring Results

Location 1 (meter ref. SMENK-9E5DF)

# Broadband Results	Date	Time	LAeq(60min)	LAeq(7hr)	LAeq(10hr)	LAeq(5hr)
	[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]	[dB]
	2025-07-28	09:00:00	65.5	-.-	-.-	-.-
	2025-07-28	10:00:00	66.2	-.-	-.-	-.-
	2025-07-28	11:00:00	65.5	-.-	-.-	-.-
	2025-07-28	12:00:00	65.7	-.-	-.-	-.-
	2025-07-28	13:00:00	63.6	-.-	-.-	-.-
	2025-07-28	14:00:00	66.0	-.-	-.-	-.-
	2025-07-28	15:00:00	65.3	-.-	-.-	-.-
	2025-07-28	16:00:00	66.9	-.-	-.-	-.-
	2025-07-28	17:00:00	64.4	-.-	-.-	-.-
	2025-07-28	18:00:00	64.2	-.-	65.4	-.-
	2025-07-29	09:00:00	66.5	-.-	-.-	-.-
	2025-07-29	10:00:00	65.8	-.-	-.-	-.-
	2025-07-29	11:00:00	66.1	-.-	-.-	-.-
	2025-07-29	12:00:00	66.6	-.-	-.-	-.-
	2025-07-29	13:00:00	63.4	-.-	-.-	-.-
	2025-07-29	14:00:00	66.8	-.-	-.-	-.-
	2025-07-29	15:00:00	65.6	-.-	-.-	-.-
	2025-07-29	16:00:00	67.5	-.-	-.-	-.-
	2025-07-29	17:00:00	65.7	-.-	-.-	-.-
	2025-07-29	18:00:00	62.7	-.-	65.9	-.-
	2025-07-30	09:00:00	68.1	-.-	-.-	-.-
	2025-07-30	10:00:00	67.2	-.-	-.-	-.-
	2025-07-30	11:00:00	65.3	-.-	-.-	-.-
	2025-07-30	12:00:00	65.6	-.-	-.-	-.-
	2025-07-30	13:00:00	65.1	-.-	-.-	-.-
	2025-07-30	14:00:00	65.7	-.-	-.-	-.-
	2025-07-30	15:00:00	65.1	-.-	-.-	-.-
	2025-07-30	16:00:00	66.0	-.-	-.-	-.-
	2025-07-30	17:00:00	63.9	-.-	-.-	-.-
	2025-07-30	18:00:00	64.5	-.-	65.8	-.-
	2025-07-31	09:00:00	67.7	-.-	-.-	-.-
	2025-07-31	10:00:00	68.1	-.-	-.-	-.-
	2025-07-31	11:00:00	68.7	-.-	-.-	-.-
	2025-07-31	12:00:00	68.5	-.-	-.-	-.-
	2025-07-31	13:00:00	66.5	-.-	-.-	-.-
	2025-07-31	14:00:00	66.1	-.-	-.-	-.-
	2025-07-31	15:00:00	66.8	-.-	-.-	-.-
	2025-07-31	16:00:00	68.0	-.-	-.-	-.-
	2025-07-31	17:00:00	67.4	-.-	-.-	-.-
	2025-07-31	18:00:00	63.2	-.-	67.3	-.-
	2025-08-01	09:00:00	68.5	-.-	-.-	-.-
	2025-08-01	10:00:00	68.5	-.-	-.-	-.-
	2025-08-01	11:00:00	69.1	-.-	-.-	-.-
	2025-08-01	12:00:00	68.8	-.-	-.-	-.-
	2025-08-01	13:00:00	67.4	-.-	-.-	-.-
	2025-08-01	14:00:00	69.6	-.-	-.-	-.-
	2025-08-01	15:00:00	68.6	-.-	-.-	-.-
	2025-08-01	16:00:00	67.2	-.-	-.-	-.-
	2025-08-01	17:00:00	67.1	-.-	-.-	-.-
	2025-08-01	18:00:00	62.8	-.-	68.1	-.-
	2025-08-02	09:00:00	60.6	-.-	-.-	-.-
	2025-08-02	10:00:00	61.4	-.-	-.-	-.-
	2025-08-02	11:00:00	64.1	-.-	-.-	-.-
	2025-08-02	12:00:00	63.3	-.-	-.-	-.-
	2025-08-02	13:00:00	62.0	-.-	-.-	62.5
	2025-08-03	09:00:00	66.6	-.-	61.3	-.-
	2025-08-04	10:00:00	66.8	-.-	-.-	-.-
	2025-08-04	11:00:00	66.6	-.-	-.-	-.-
	2025-08-04	12:00:00	67.7	-.-	-.-	-.-
	2025-08-04	13:00:00	67.1	-.-	-.-	-.-
	2025-08-04	14:00:00	68.1	-.-	-.-	-.-
	2025-08-04	15:00:00	68.2	-.-	-.-	-.-
	2025-08-04	16:00:00	66.8	-.-	-.-	-.-
	2025-08-04	17:00:00	65.3	-.-	-.-	-.-
	2025-08-04	18:00:00	63.5	-.-	66.9	-.-
	2025-08-05	09:00:00	66.9	-.-	-.-	-.-
	2025-08-05	10:00:00	67.3	-.-	-.-	-.-
	2025-08-05	11:00:00	64.7	-.-	-.-	-.-
	2025-08-05	12:00:00	65.8	-.-	-.-	-.-
	2025-08-05	13:00:00	64.6	-.-	-.-	-.-
	2025-08-05	14:00:00	66.8	-.-	-.-	-.-
	2025-08-05	15:00:00	68.3	-.-	-.-	-.-
	2025-08-05	16:00:00	68.4	-.-	-.-	-.-
	2025-08-05	17:00:00	66.6	-.-	-.-	-.-
	2025-08-05	18:00:00	63.1	-.-	66.5	-.-
	2025-08-06	09:00:00	69.3	-.-	-.-	-.-
	2025-08-06	10:00:00	72.4	-.-	-.-	-.-
	2025-08-06	11:00:00	69.7	-.-	-.-	-.-
	2025-08-06	12:00:00	69.8	-.-	-.-	-.-
	2025-08-06	13:00:00	64.8	-.-	-.-	-.-
	2025-08-06	14:00:00	69.2	-.-	-.-	-.-
	2025-08-06	15:00:00	71.2	-.-	-.-	-.-
	2025-08-06	16:00:00	72.3	-.-	-.-	-.-
	2025-08-06	17:00:00	71.0	-.-	-.-	-.-
	2025-08-06	18:00:00	63.7	-.-	70.1	-.-
	2025-08-07	09:00:00	71.4	-.-	-.-	-.-
	2025-08-07	10:00:00	73.0	-.-	-.-	-.-
	2025-08-07	11:00:00	72.8	-.-	-.-	-.-
	2025-08-07	12:00:00	71.7	-.-	-.-	-.-
	2025-08-07	13:00:00	68.6	-.-	-.-	-.-
	2025-08-07	14:00:00	72.9	-.-	-.-	-.-
	2025-08-07	15:00:00	68.3	-.-	-.-	-.-
	2025-08-07	16:00:00	69.0	-.-	-.-	-.-
	2025-08-07	17:00:00	72.7	-.-	-.-	-.-
	2025-08-07	18:00:00	66.8	-.-	71.2	-.-
	2025-08-08	09:00:00	72.8	-.-	-.-	-.-
	2025-08-08	10:00:00	74.2	-.-	-.-	-.-
	2025-08-08	11:00:00	72.4	-.-	-.-	-.-
	2025-08-08	12:00:00	71.6	-.-	-.-	-.-
	2025-08-08	13:00:00	67.8	-.-	-.-	-.-
	2025-08-08	14:00:00	68.9	-.-	-.-	-.-
	2025-08-08	15:00:00	75.3	-.-	-.-	-.-
	2025-08-08	16:00:00	71.1	-.-	-.-	-.-
	2025-08-08	17:00:00	65.2	-.-	-.-	-.-
	2025-08-08	18:00:00	63.3	-.-	71.6	-.-
	2025-08-09	09:00:00	63.4	-.-	-.-	-.-
	2025-08-09	10:00:00	61.6	-.-	-.-	-.-
	2025-08-09	11:00:00	61.4	-.-	-.-	-.-
	2025-08-09	12:00:00	61.5	-.-	-.-	-.-
	2025-08-09	13:00:00	63.5	-.-	-.-	62.4

Location 1 (meter ref. SMENK-9E5DF) – Time History Data

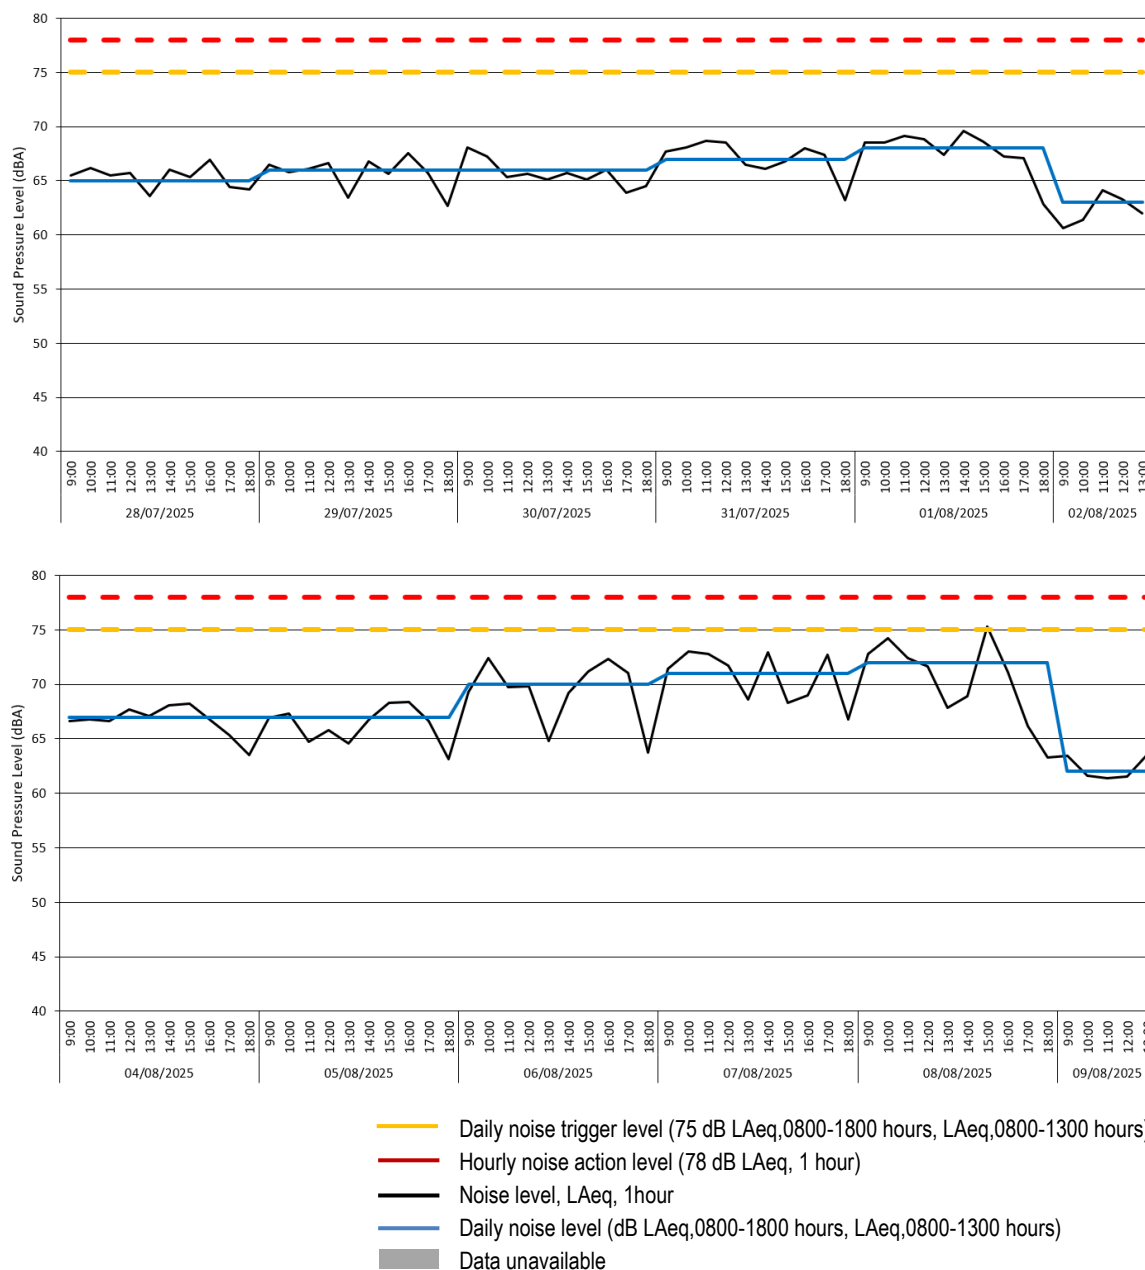


3.6 There was 100% data coverage at Location 1 during construction hours for the monitoring period covered by this report. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) or hourly noise action level (78 dB LAeq,1 hour) at this location for the monitoring period covered by this report.

Location 2 (meter ref. VFHMP-7XSY7)

# Broadband Results				
Date	Time	LAeq(60min)	LAeq(10hr)	LAeq(5hr)
[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]
2025-07-28	09:00:00	73.1	--	--
2025-07-28	10:00:00	72.1	--	--
2025-07-28	11:00:00	69.1	--	--
2025-07-28	12:00:00	70.3	--	--
2025-07-28	13:00:00	66.5	--	--
2025-07-28	14:00:00	57.7	--	--
2025-07-28	15:00:00	61.6	--	--
2025-07-28	16:00:00	66.9	--	--
2025-07-28	17:00:00	68.9	--	--
2025-07-28	18:00:00	62.7	68.8	--
2025-07-29	09:00:00	66.6	--	--
2025-07-29	10:00:00	70.4	--	--
2025-07-29	11:00:00	69.4	--	--
2025-07-29	12:00:00	68.5	--	--
2025-07-29	13:00:00	69.4	--	--
2025-07-29	14:00:00	67.2	--	--
2025-07-29	15:00:00	65.2	--	--
2025-07-29	16:00:00	63.2	--	--
2025-07-29	17:00:00	66.6	--	--
2025-07-29	18:00:00	69.5	67.5	--
2025-07-30	09:00:00	70.4	--	--
2025-07-30	10:00:00	72.9	--	--
2025-07-30	11:00:00	71.1	--	--
2025-07-30	12:00:00	69.3	--	--
2025-07-30	13:00:00	67.2	--	--
2025-07-30	14:00:00	69.3	--	--
2025-07-30	15:00:00	73.7	--	--
2025-07-30	16:00:00	72.5	--	--
2025-07-30	17:00:00	72.9	--	--
2025-07-30	18:00:00	70.8	71.4	--
2025-07-31	09:00:00	70.6	--	--
2025-07-31	10:00:00	70.0	--	--
2025-07-31	11:00:00	68.0	--	--
2025-07-31	12:00:00	59.3	--	--
2025-07-31	13:00:00	58.8	--	--
2025-07-31	14:00:00	59.5	--	--
2025-07-31	15:00:00	60.2	--	--
2025-07-31	16:00:00	59.1	--	--
2025-07-31	17:00:00	61.0	--	--
2025-07-31	18:00:00	65.3	65.6	--
2025-08-01	09:00:00	63.4	--	--
2025-08-01	10:00:00	61.3	--	--
2025-08-01	11:00:00	62.4	--	--
2025-08-01	12:00:00	63.6	--	--
2025-08-01	13:00:00	60.7	--	--
2025-08-01	14:00:00	62.5	--	--
2025-08-01	15:00:00	66.0	--	--
2025-08-01	16:00:00	62.7	--	--
2025-08-01	17:00:00	67.9	--	--
2025-08-01	18:00:00	58.6	63.7	--
2025-08-02	09:00:00	43.6	--	--
2025-08-02	10:00:00	45.2	--	--
2025-08-02	11:00:00	51.4	--	--
2025-08-02	12:00:00	44.2	--	--
2025-08-02	13:00:00	48.4	--	47.6
2025-08-03	09:00:00	--	44.6	--
2025-08-04	09:00:00	61.1	--	--
2025-08-04	10:00:00	62.9	--	--
2025-08-04	11:00:00	61.2	--	--
2025-08-04	12:00:00	58.8	--	--
2025-08-04	13:00:00	57.9	--	--
2025-08-04	14:00:00	58.7	--	--
2025-08-04	15:00:00	58.4	--	--
2025-08-04	16:00:00	58.3	--	--
2025-08-04	17:00:00	57.3	--	--
2025-08-04	18:00:00	56.5	59.6	--
2025-08-05	09:00:00	61.0	--	--
2025-08-05	10:00:00	59.3	--	--
2025-08-05	11:00:00	54.4	--	--
2025-08-05	12:00:00	53.1	--	--
2025-08-05	13:00:00	53.6	--	--
2025-08-05	14:00:00	56.9	--	--
2025-08-05	15:00:00	56.0	--	--
2025-08-05	16:00:00	57.6	--	--
2025-08-05	17:00:00	57.1	--	--
2025-08-05	18:00:00	50.6	56.9	--
2025-08-06	09:00:00	61.7	--	--
2025-08-06	10:00:00	62.4	--	--
2025-08-06	11:00:00	73.0	--	--
2025-08-06	12:00:00	71.7	--	--
2025-08-06	13:00:00	60.7	--	--
2025-08-06	14:00:00	64.9	--	--
2025-08-06	15:00:00	72.3	--	--
2025-08-06	16:00:00	74.6	--	--
2025-08-06	17:00:00	71.8	--	--
2025-08-06	18:00:00	46.0	70.1	--
2025-08-07	09:00:00	71.0	--	--
2025-08-07	10:00:00	75.9	--	--
2025-08-07	11:00:00	80.7	--	--
2025-08-07	12:00:00	74.3	--	--
2025-08-07	13:00:00	70.4	--	--
2025-08-07	14:00:00	69.5	--	--
2025-08-07	15:00:00	67.8	--	--
2025-08-07	16:00:00	62.7	--	--
2025-08-07	17:00:00	58.8	--	--
2025-08-07	18:00:00	50.4	73.5	--
2025-08-08	09:00:00	60.1	--	--
2025-08-08	10:00:00	60.4	--	--
2025-08-08	11:00:00	58.9	--	--
2025-08-08	12:00:00	59.1	--	--
2025-08-08	13:00:00	52.4	--	--
2025-08-08	14:00:00	62.4	--	--
2025-08-08	15:00:00	55.5	--	--
2025-08-08	16:00:00	52.8	--	--
2025-08-08	17:00:00	59.1	--	--
2025-08-08	18:00:00	50.8	58.5	--
2025-08-09	09:00:00	41.9	--	--
2025-08-09	10:00:00	45.8	--	--
2025-08-09	11:00:00	44.3	--	--
2025-08-09	12:00:00	45.3	--	--
2025-08-09	13:00:00	46.3	--	45.0

Location 2 (meter ref. VFHMP-7XSY7) – Time History Data

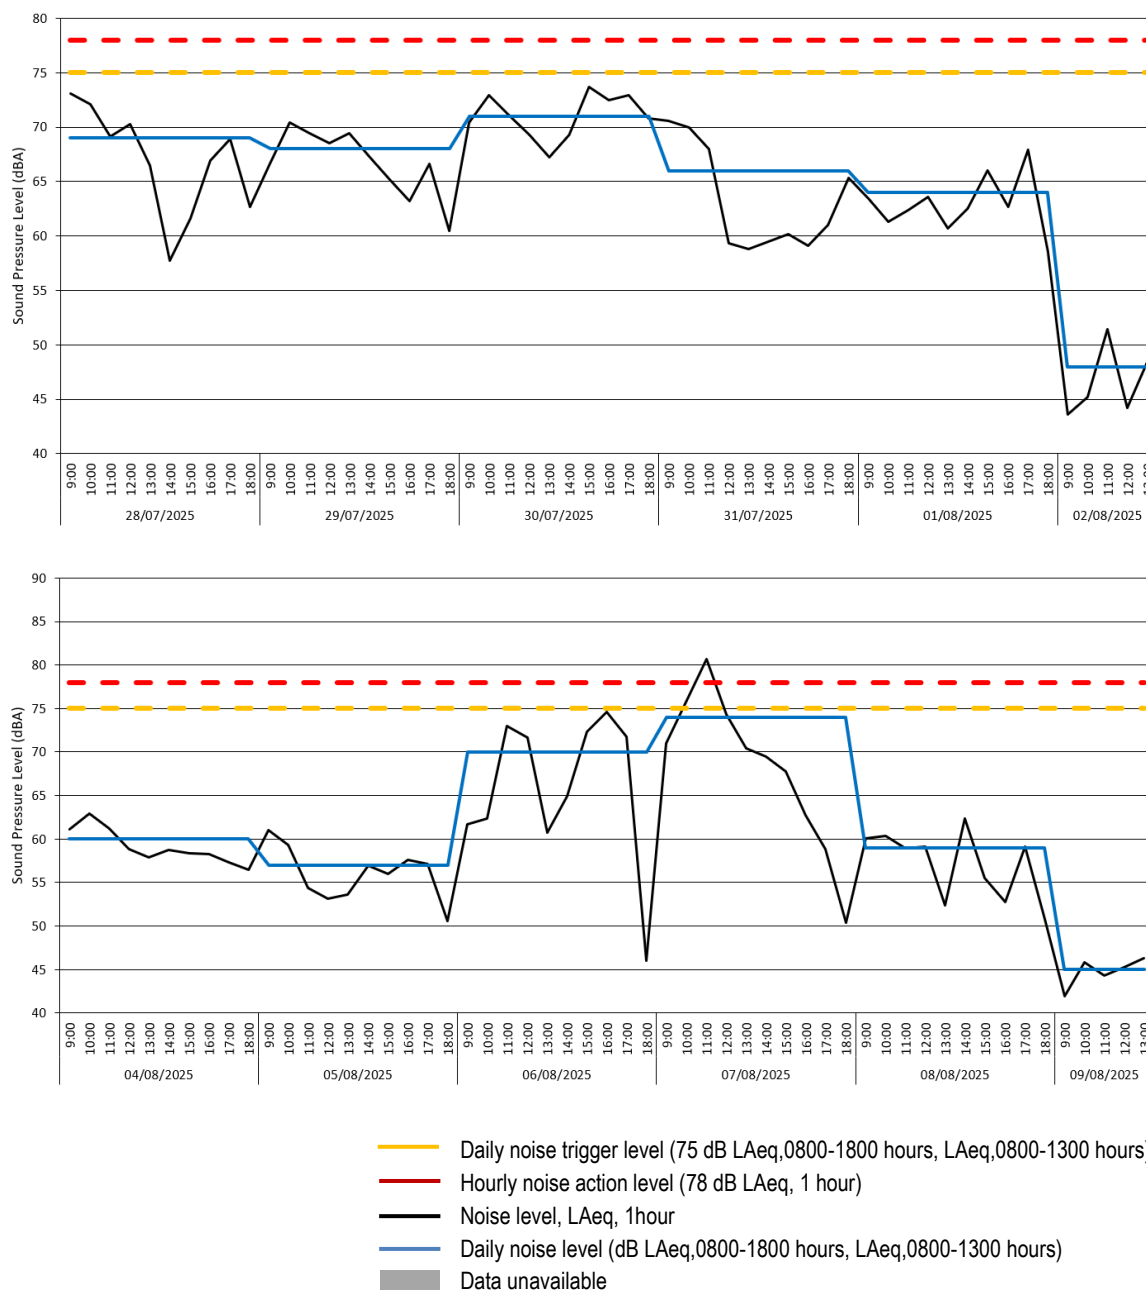


- 3.8 There was 100% data coverage at Location 2 during construction hours for the monitoring period covered by this report. There was one exceedance of the hourly noise action level, which occurred at 11:00 on Thursday 7th August, with a measured noise level of 80.7 dB LAeq,1hr. Based on discussions with site management, this was understood to have been caused by work taking place within the proximity of Block E; in particular, the groundworks team who have been working on the nearby water pipe installation. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) at this location during the monitoring period covered by this report, including on the day during which the hourly noise action level was exceeded.

Location 3 (meter ref. P5DLY-N3J7A) – Raw Data

# Broadband Results	Date	Time	LAeq(60min)	LAeq(10hr)	LAeq(5hr)
	[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]
	2025-07-28	09:00:00	62.2	-.-	-.-
	2025-07-28	10:00:00	61.1	-.-	-.-
	2025-07-28	11:00:00	61.2	-.-	-.-
	2025-07-28	12:00:00	56.1	-.-	-.-
	2025-07-28	13:00:00	54.8	-.-	-.-
	2025-07-28	14:00:00	54.2	-.-	-.-
	2025-07-28	15:00:00	57.0	-.-	-.-
	2025-07-28	16:00:00	60.0	-.-	-.-
	2025-07-28	17:00:00	61.1	-.-	-.-
	2025-07-28	18:00:00	51.1	59.1	-.-
	2025-07-29	09:00:00	60.6	-.-	-.-
	2025-07-29	10:00:00	60.2	-.-	-.-
	2025-07-29	11:00:00	59.2	-.-	-.-
	2025-07-29	12:00:00	60.3	-.-	-.-
	2025-07-29	13:00:00	57.8	-.-	-.-
	2025-07-29	14:00:00	58.5	-.-	-.-
	2025-07-29	15:00:00	58.7	-.-	-.-
	2025-07-29	16:00:00	57.5	-.-	-.-
	2025-07-29	17:00:00	56.3	-.-	-.-
	2025-07-29	18:00:00	51.8	58.6	-.-
	2025-07-30	09:00:00	76.6	-.-	-.-
	2025-07-30	10:00:00	72.9	-.-	-.-
	2025-07-30	11:00:00	69.8	-.-	-.-
	2025-07-30	12:00:00	64.9	-.-	-.-
	2025-07-30	13:00:00	66.6	-.-	-.-
	2025-07-30	14:00:00	61.1	-.-	-.-
	2025-07-30	15:00:00	65.0	-.-	-.-
	2025-07-30	16:00:00	64.6	-.-	-.-
	2025-07-30	17:00:00	54.9	-.-	-.-
	2025-07-30	18:00:00	48.1	69.5	-.-
	2025-07-31	09:00:00	59.9	-.-	-.-
	2025-07-31	10:00:00	60.0	-.-	-.-
	2025-07-31	11:00:00	59.1	-.-	-.-
	2025-07-31	12:00:00	59.4	-.-	-.-
	2025-07-31	13:00:00	56.8	-.-	-.-
	2025-07-31	14:00:00	55.6	-.-	-.-
	2025-07-31	15:00:00	59.3	-.-	-.-
	2025-07-31	16:00:00	60.7	-.-	-.-
	2025-07-31	17:00:00	59.1	-.-	-.-
	2025-07-31	18:00:00	63.1	59.7	-.-
	2025-08-01	09:00:00	58.7	-.-	-.-
	2025-08-01	10:00:00	57.4	-.-	-.-
	2025-08-01	11:00:00	58.1	-.-	-.-
	2025-08-01	12:00:00	55.9	-.-	-.-
	2025-08-01	13:00:00	54.5	-.-	-.-
	2025-08-01	14:00:00	58.3	-.-	-.-
	2025-08-01	15:00:00	60.9	-.-	-.-
	2025-08-01	16:00:00	55.3	-.-	-.-
	2025-08-01	17:00:00	57.7	-.-	-.-
	2025-08-01	18:00:00	50.2	57.4	-.-
	2025-08-02	09:00:00	43.9	-.-	-.-
	2025-08-02	10:00:00	46.2	-.-	-.-
	2025-08-02	11:00:00	50.0	-.-	-.-
	2025-08-02	12:00:00	45.7	-.-	-.-
	2025-08-02	13:00:00	50.1	-.-	47.9
	2025-08-03	18:00:00	-.-	47.0	-.-
	2025-08-04	09:00:00	71.0	-.-	-.-
	2025-08-04	10:00:00	64.7	-.-	-.-
	2025-08-04	11:00:00	58.7	-.-	-.-
	2025-08-04	12:00:00	61.1	-.-	-.-
	2025-08-04	13:00:00	67.8	-.-	-.-
	2025-08-04	14:00:00	65.9	-.-	-.-
	2025-08-04	15:00:00	72.8	-.-	-.-
	2025-08-04	16:00:00	73.3	-.-	-.-
	2025-08-04	17:00:00	61.6	-.-	-.-
	2025-08-04	18:00:00	54.7	68.4	-.-
	2025-08-05	09:00:00	73.8	-.-	-.-
	2025-08-05	10:00:00	79.9	-.-	-.-
	2025-08-05	11:00:00	71.4	-.-	-.-
	2025-08-05	12:00:00	56.5	-.-	-.-
	2025-08-05	13:00:00	61.7	-.-	-.-
	2025-08-05	14:00:00	61.0	-.-	-.-
	2025-08-05	15:00:00	61.5	-.-	-.-
	2025-08-05	16:00:00	62.2	-.-	-.-
	2025-08-05	17:00:00	59.7	-.-	-.-
	2025-08-05	18:00:00	58.8	71.6	-.-
	2025-08-06	09:00:00	58.2	-.-	-.-
	2025-08-06	10:00:00	57.5	-.-	-.-
	2025-08-06	11:00:00	62.8	-.-	-.-
	2025-08-06	12:00:00	61.9	-.-	-.-
	2025-08-06	13:00:00	60.1	-.-	-.-
	2025-08-06	14:00:00	60.5	-.-	-.-
	2025-08-06	15:00:00	55.6	-.-	-.-
	2025-08-06	16:00:00	57.5	-.-	-.-
	2025-08-06	17:00:00	54.8	-.-	-.-
	2025-08-06	18:00:00	49.3	59.1	-.-
	2025-08-07	09:00:00	59.6	-.-	-.-
	2025-08-07	10:00:00	76.8	-.-	-.-
	2025-08-07	11:00:00	59.2	-.-	-.-
	2025-08-07	12:00:00	57.2	-.-	-.-
	2025-08-07	13:00:00	56.2	-.-	-.-
	2025-08-07	14:00:00	54.6	-.-	-.-
	2025-08-07	15:00:00	57.7	-.-	-.-
	2025-08-07	16:00:00	58.5	-.-	-.-
	2025-08-07	17:00:00	55.1	-.-	-.-
	2025-08-07	18:00:00	50.5	67.2	-.-
	2025-08-08	09:00:00	62.1	-.-	-.-
	2025-08-08	10:00:00	60.9	-.-	-.-
	2025-08-08	11:00:00	59.4	-.-	-.-
	2025-08-08	12:00:00	58.6	-.-	-.-
	2025-08-08	13:00:00	52.8	-.-	-.-
	2025-08-08	14:00:00	77.3	-.-	-.-
	2025-08-08	15:00:00	64.8	-.-	-.-
	2025-08-08	16:00:00	55.2	-.-	-.-
	2025-08-08	17:00:00	67.3	-.-	-.-
	2025-08-08	18:00:00	49.9	68.3	-.-
	2025-08-09	09:00:00	52.5	-.-	-.-
	2025-08-09	10:00:00	52.4	-.-	-.-
	2025-08-09	11:00:00	45.4	-.-	-.-
	2025-08-09	12:00:00	46.6	-.-	-.-
	2025-08-09	13:00:00	48.9	-.-	50.1

Location 3 (meter ref. P5DLY-N3J7A) – Time-history graph

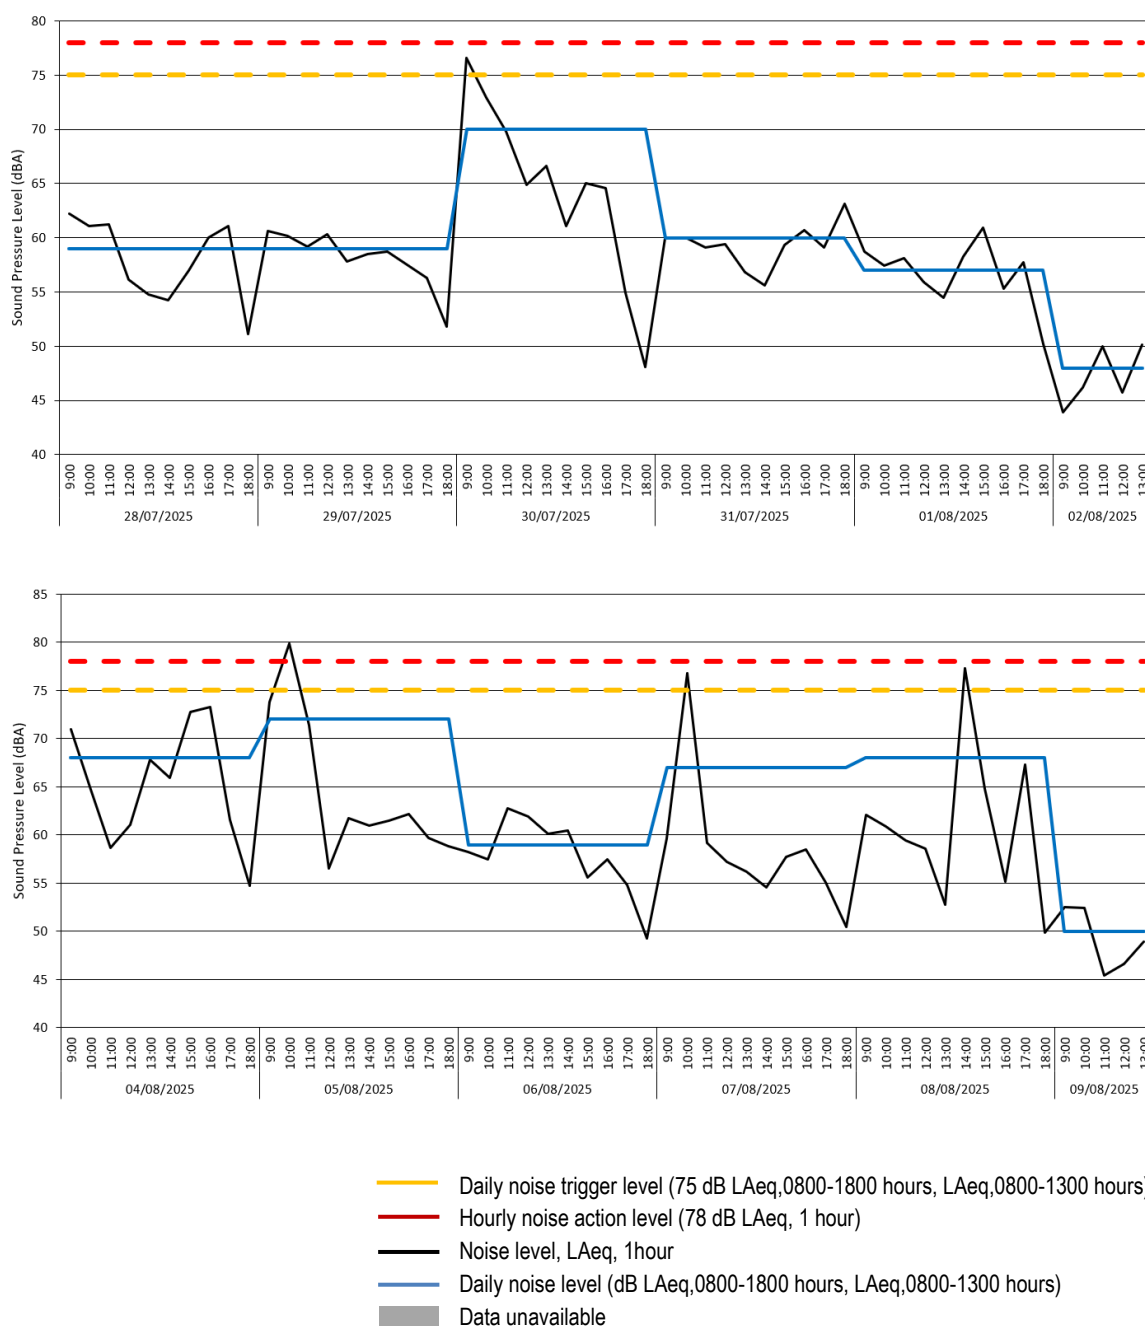

- 3.9 There was 100% data coverage at Location 3 during construction hours for the monitoring period covered by this report. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) at this location for the monitoring period covered by this report. There was one exceedance of the hourly noise action level (78 dB LAeq,1 hour), which took place at 10:00 on Tuesday 5th August, with a measured noise level of 79.9 dB LAeq,1hour. Based on discussions with site management, this is likely to have been caused by parking bay formation work taking place within the vicinity of the monitoring location. It is positive that the daily noise trigger level was not exceeded.

Vibration Monitoring Results


Location 1 (meter ref. PIJIVI) – Raw data

Measuring point: Holloway - L1
Period: 2025-07-28_000000.000- - 1

Criteria mm/s PPV Exceedances
1.0 3

Order	Value	Date	Time
1	1.15	04/08/2025	13:28
2	1.08	05/08/2025	17:10
3	1.06	28/07/2025	10:51
4	0.94	01/08/2025	16:52
5	0.90	30/07/2025	09:12
6	0.62	04/08/2025	15:01
7	0.62	07/08/2025	09:33
8	0.55	07/08/2025	09:20
9	0.50	01/08/2025	15:51
10	0.46	01/08/2025	16:49

Location 1 (meter ref. PIJIVI) – Time history graph

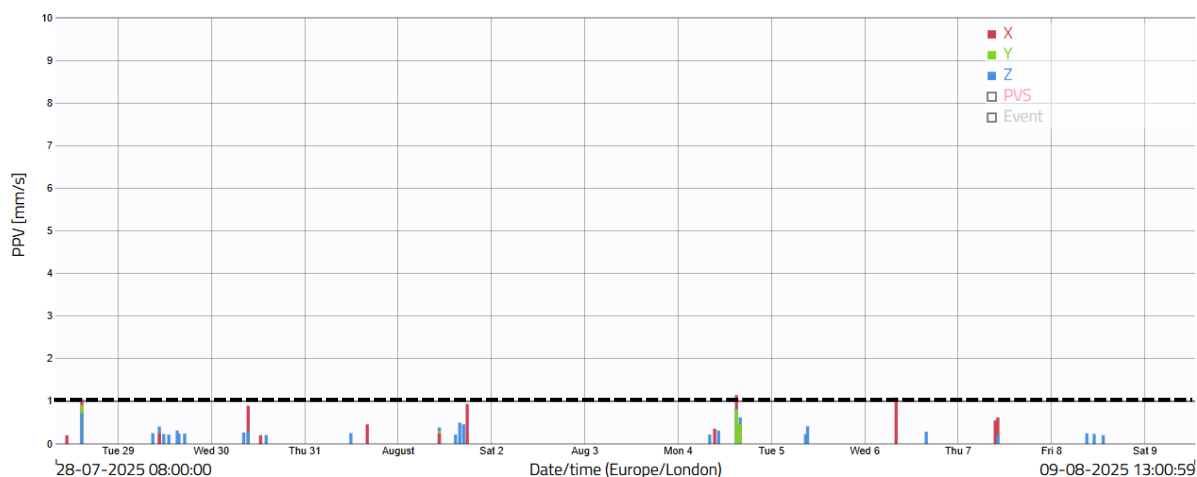


— X axis, PPV (mm/s) — Y axis, PPV (mm/s) — Z axis, PPV (mm/s) Trigger level (1 mm/s PPV)

- 3.10 There was 100% data coverage at Location 1 during construction hours for the monitoring period covered by this report. There were three exceedances of the project vibration trigger level of 1.0 mm/s PPV, as shown in the raw data and graph above. This occurred at 13:28 on Monday 4th August, with a recorded level of 1.2 mm/s PPV. Based on discussions with site management, this was understood to have been caused by work taking place at Block C, including scaffolding work.

Location 2 (meter ref. LEQUMO) – Raw data

Measuring point:	Period:	Order	Value	Date	Time	Order	Value	Date	Time	Order	Value	Date	Time
Holloway - L2	2025-07-28_000000.000--1	1	22.59	28/07/2025	08:17	31	3.31	30/07/2025	14:15	61	2.46	28/07/2025	10:54
		2	21.08	28/07/2025	08:55	32	3.28	28/07/2025	10:17	62	2.46	30/07/2025	14:10
Criteria mm/s PPV	Exceedances	3	20.35	28/07/2025	08:58	33	3.24	28/07/2025	08:36	63	2.42	30/07/2025	14:16
1.0	276	4	19.17	28/07/2025	08:54	34	3.23	30/07/2025	17:19	64	2.42	30/07/2025	14:44
		5	15.14	30/07/2025	17:08	35	3.21	30/07/2025	14:31	65	2.39	28/07/2025	09:47
		6	12.22	28/07/2025	09:31	36	3.20	28/07/2025	09:02	66	2.39	30/07/2025	13:53
		7	11.14	28/07/2025	09:32	37	3.13	30/07/2025	14:41	67	2.33	30/07/2025	14:30
		8	10.15	28/07/2025	08:37	38	3.07	28/07/2025	08:59	68	2.28	28/07/2025	10:32
		9	9.74	28/07/2025	08:53	39	2.96	30/07/2025	14:43	69	2.27	31/07/2025	17:16
		10	9.35	28/07/2025	08:57	40	2.95	30/07/2025	14:32	70	2.26	28/07/2025	08:14
		11	6.21	28/07/2025	11:00	41	2.92	28/07/2025	09:41	71	2.25	28/07/2025	09:40
		12	6.16	28/07/2025	09:34	42	2.91	30/07/2025	14:21	72	2.24	28/07/2025	10:55
		13	6.10	28/07/2025	08:48	43	2.91	30/07/2025	14:38	73	2.24	28/07/2025	09:28
		14	6.08	28/07/2025	09:35	44	2.89	30/07/2025	14:29	74	2.23	28/07/2025	08:35
		15	5.92	28/07/2025	08:49	45	2.81	30/07/2025	14:25	75	2.23	31/07/2025	17:13
		16	5.60	28/07/2025	10:58	46	2.79	28/07/2025	10:19	76	2.21	31/07/2025	17:11
		17	5.42	28/07/2025	09:39	47	2.78	28/07/2025	08:56	77	2.21	28/07/2025	10:07
		18	4.92	28/07/2025	09:33	48	2.77	28/07/2025	10:04	78	2.21	30/07/2025	13:44
		19	4.67	30/07/2025	17:18	49	2.76	28/07/2025	11:01	79	2.17	28/07/2025	08:41
		20	4.39	28/07/2025	09:43	50	2.71	30/07/2025	14:20	80	2.16	30/07/2025	13:48
		21	4.20	28/07/2025	10:57	51	2.67	31/07/2025	08:00	81	2.16	28/07/2025	08:40
		22	4.17	06/08/2025	15:54	52	2.64	28/07/2025	09:30	82	2.16	30/07/2025	14:08
		23	3.84	28/07/2025	09:00	53	2.61	30/07/2025	14:26	83	2.15	30/07/2025	17:09
		24	3.84	28/07/2025	10:14	54	2.57	30/07/2025	14:22	84	2.15	30/07/2025	15:39
		25	3.83	28/07/2025	09:42	55	2.51	28/07/2025	10:49	85	2.14	31/07/2025	17:12
		26	3.72	30/07/2025	14:23	56	2.50	28/07/2025	10:28	86	2.14	30/07/2025	14:09
		27	3.69	28/07/2025	09:38	57	2.49	28/07/2025	10:29	87	2.10	01/08/2025	08:02
		28	3.55	28/07/2025	10:59	58	2.48	30/07/2025	14:37	88	2.09	28/07/2025	08:47
		29	3.48	30/07/2025	14:19	59	2.48	28/07/2025	08:43	89	2.09	30/07/2025	17:12
		30	3.36	28/07/2025	08:46	60	2.47	28/07/2025	08:50	90	2.07	30/07/2025	15:04

Location 2 (meter ref. LEQUMO) – Time-history graph

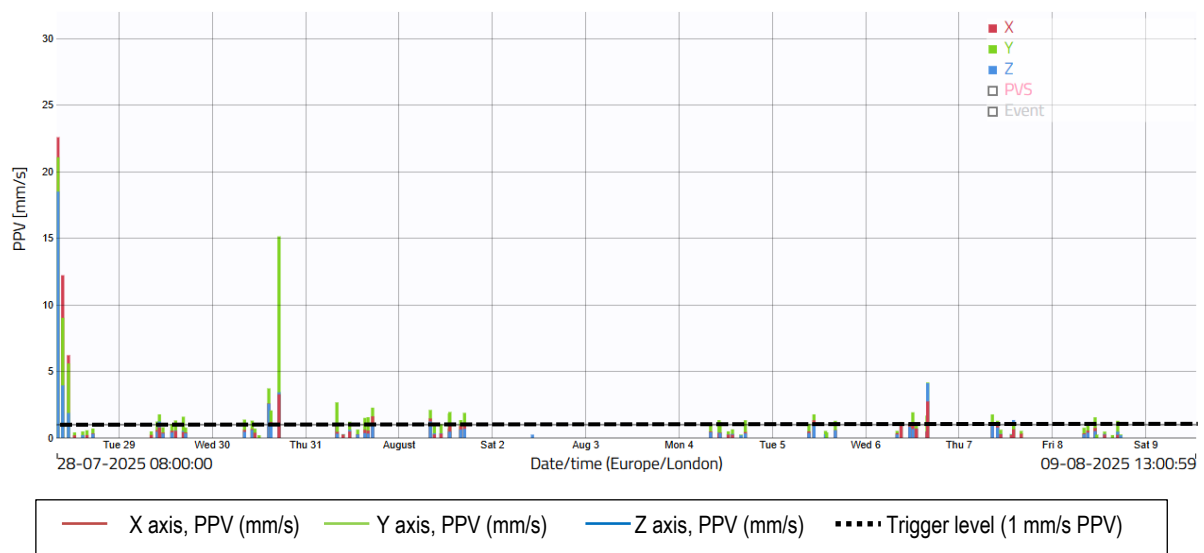


- 3.12 There was 100% data coverage at Location 2 during construction hours for the monitoring period covered by this report. There were 276 exceedances of the project vibration trigger level of 1.0 mm/s PPV, as shown in the raw data and graph above. The highest recorded vibration level took place on Monday 28th July at 08:17, with a recorded level of 22.6 mm/s PPV.

3.13 Based on discussions with site management, this was understood to have been caused by work taking place within the proximity of Block E; in particular, the groundworks team who have been working on the nearby water pipe installation. This will continue to be monitored.

Location 3 (meter ref. RIYORU) – Raw data

Measuring point:	Period:	Order	Value	Date	Time	Order	Value	Date	Time	Order	Value	Date	Time
Holloway - L3	2025-07-28_000000.000 - 1	1	8.51	05/08/2025	08:38	31	2.84	05/08/2025	09:25	61	1.85	08/08/2025	13:44
Criteria mm/s PPV	Exceedances	2	6.70	05/08/2025	09:16	32	2.72	05/08/2025	08:44	62	1.85	05/08/2025	09:10
4.0	13	3	6.57	05/08/2025	09:17	33	2.71	07/08/2025	09:42	63	1.85	30/07/2025	08:23
		4	6.56	05/08/2025	08:37	34	2.70	05/08/2025	09:28	64	1.82	04/08/2025	14:17
		5	5.71	05/08/2025	09:22	35	2.68	07/08/2025	09:19	65	1.81	05/08/2025	10:21
		6	4.90	07/08/2025	09:44	36	2.68	05/08/2025	08:41	66	1.80	07/08/2025	09:40
		7	4.56	05/08/2025	09:31	37	2.59	05/08/2025	09:20	67	1.78	04/08/2025	14:02
		8	4.47	05/08/2025	09:30	38	2.55	05/08/2025	10:09	68	1.76	05/08/2025	09:37
		9	4.26	05/08/2025	09:33	39	2.49	05/08/2025	09:44	69	1.74	04/08/2025	15:07
		10	4.25	05/08/2025	09:18	40	2.35	05/08/2025	08:30	70	1.74	05/08/2025	10:13
		11	4.23	05/08/2025	09:40	41	2.31	05/08/2025	09:27	71	1.73	07/08/2025	09:14
		12	4.21	05/08/2025	09:42	42	2.26	05/08/2025	08:40	72	1.71	08/08/2025	13:57
		13	4.19	05/08/2025	09:26	43	2.23	04/08/2025	08:33	73	1.70	04/08/2025	08:46
		14	3.88	05/08/2025	08:43	44	2.21	05/08/2025	09:43	74	1.68	07/08/2025	09:37
		15	3.60	05/08/2025	09:39	45	2.21	05/08/2025	08:42	75	1.66	08/08/2025	14:02
		16	3.58	05/08/2025	09:14	46	2.19	05/08/2025	09:41	76	1.65	05/08/2025	09:32
		17	3.54	04/08/2025	08:45	47	2.14	04/08/2025	15:18	77	1.65	04/08/2025	14:14
		18	3.39	07/08/2025	09:43	48	2.11	07/08/2025	09:34	78	1.63	08/08/2025	13:09
		19	3.36	05/08/2025	09:19	49	2.10	05/08/2025	09:36	79	1.58	05/08/2025	08:47
		20	3.33	05/08/2025	09:45	50	2.07	04/08/2025	15:24	80	1.58	04/08/2025	15:27
		21	3.10	05/08/2025	08:45	51	2.04	05/08/2025	09:04	81	1.55	04/08/2025	14:24
		22	3.03	04/08/2025	08:44	52	2.03	05/08/2025	09:23	82	1.55	07/08/2025	09:41
		23	2.99	05/08/2025	09:15	53	2.03	05/08/2025	10:18	83	1.54	04/08/2025	14:10
		24	2.99	05/08/2025	09:29	54	2.02	08/08/2025	13:42	84	1.52	04/08/2025	14:13
		25	2.97	05/08/2025	09:21	55	1.99	28/07/2025	09:08	85	1.50	05/08/2025	10:16
		26	2.94	05/08/2025	09:12	56	1.97	04/08/2025	14:27	86	1.50	04/08/2025	12:39
		27	2.93	05/08/2025	09:46	57	1.97	07/08/2025	09:38	87	1.50	04/08/2025	13:01
		28	2.89	05/08/2025	09:24	58	1.92	04/08/2025	14:11	88	1.49	05/08/2025	09:47
		29	2.86	05/08/2025	10:19	59	1.89	07/08/2025	09:28	89	1.46	07/08/2025	09:35
		30	2.85	05/08/2025	10:17	60	1.86	08/08/2025	13:52	90	1.45	04/08/2025	14:18

Location 3 (meter ref. RIYORU) – Time-history graph

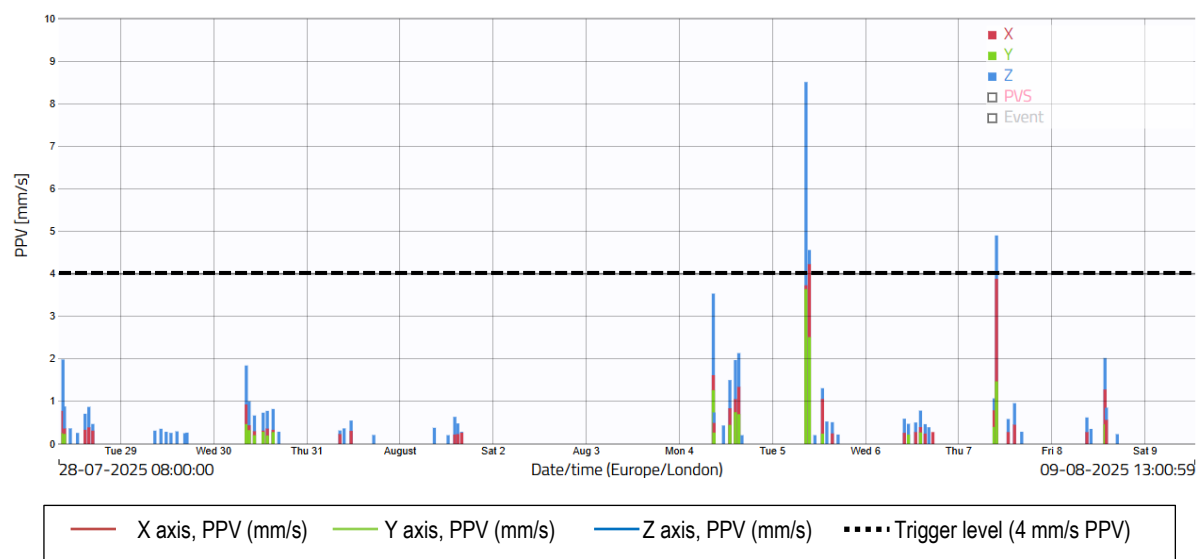


- 3.14 There was 100% data coverage at Location 3 during construction hours for the monitoring period covered by this report. There were 13 exceedances of the vibration trigger level (4 mm/s PPV) at this location during the monitoring period. The highest of these occurred on Tuesday 5th April at 08:33, with a measured level of 8.5 mm/s PPV. Based on discussions with site management, it is understood that this was caused by the parking bay formation in front of the monitoring location. This will continue to be monitored.

Location 4 (meter ref. TEJELU) – Raw data

Measuring point:	Period:	Order	Value	Date	Time
Holloway - L4	2025-07-28_000000.000- - 1	1	1.01	01/08/2025	16:21
		2	0.92	01/08/2025	16:28
Criteria mm/s PPV	Exceedances	3	0.83	01/08/2025	15:51
1.0	1	4	0.75	01/08/2025	16:05
		5	0.74	01/08/2025	15:42
		6	0.70	01/08/2025	16:03
		7	0.62	01/08/2025	16:26
		8	0.61	01/08/2025	16:13
		9	0.60	29/07/2025	10:37
		10	0.58	31/07/2025	14:49

Location 4 (meter ref. TEJELU) – Time-history graph

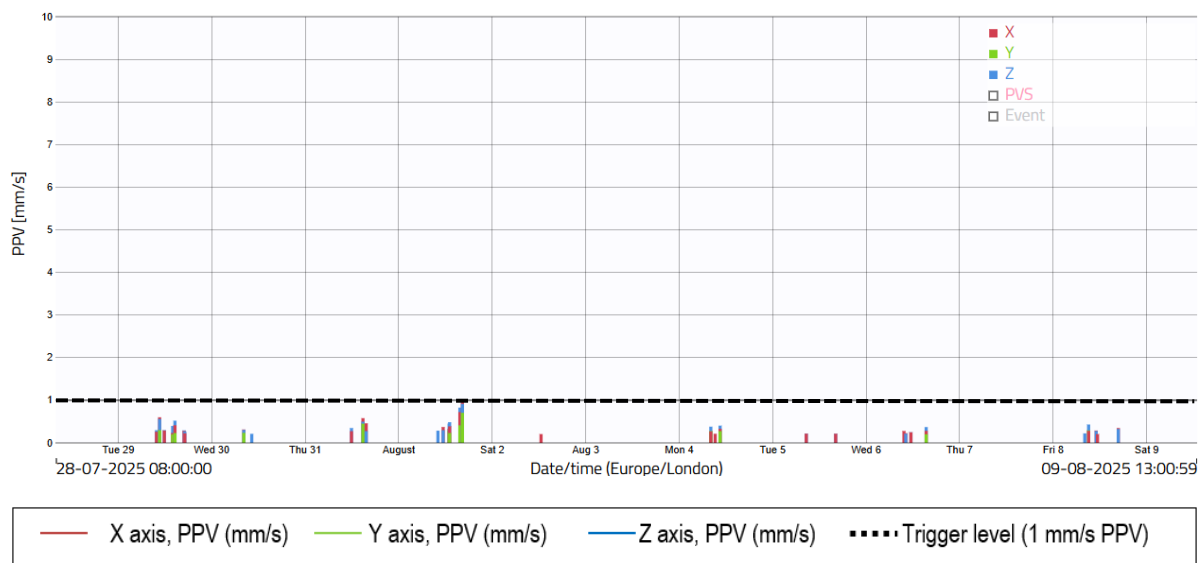

- 3.15 There was 100% data coverage at Location 4 during construction hours for the monitoring period covered by this report. There was one exceedance of the project vibration trigger level of 1.0 mm/s PPV during the monitoring period covered by this report. This took place on at 16:21 on Friday 1st August. with a measured level of 1.01 mm/s PPV. Based on discussions with site management, this was understood to have been caused by work taking place within the proximity of Block E; in particular, the groundworks team who have been working on the nearby water pipe installation. This will continue to be monitored.