

Holloway Park, London

Construction Monitoring Report

Client: London Square
Ref: CM130-22405-R0
Date: 15 April 2026
Note by: Nathan Hyde, BSc TechIOA, Acoustics Consultant
Reviewed by: Anthony Coraci, MSc DipIOA, Senior Acoustics Consultant

1. INTRODUCTION

1.1 This Technical Note sets out results of the construction monitoring being carried out at the above site between Monday 23rd March & Saturday 4th April 2026. The monitoring is being carried out in general agreement with the methodology in the current Section 61 Consent between the London Borough of Islington and London Square.

2. SITE ACTIVITIES

2.1 The following activities have been carried during the period covered by this report, in addition to the usual use of the Haul Road with site vehicles, and mobile plant used around the site:

- Drylining works at Block C
- Metsec and Facade works at Block C1, Trench excavation for water meter, within proximity of Block C1
- Brickwork across Block D, internal fitout at Block D1
- Scaffolding & waterproofing works at Blocks C&D
- Ground works taking place around the welfare area.
- Installation of services and pavements on Pankhurst Road
- Scaffolding and Metsec works around Block E.

3. MONITORING DATA

- 3.1 This section sets out a summary of the monitoring data that has been recorded onsite and provides a discussion of any exceedances and best practicable means incorporated by the site team if exceedances were believed to be construction related.

Dust Monitoring Results


Location 1 (meter ref. TNO4728)

- 3.2 There was 0% data coverage during the monitoring period, as the monitor was removed from site on Wednesday 17th December 2025 for its laboratory calibration (required every two years). This was returned to site on Friday 13th February. However, this monitor has remained offline due to water damage to the webserver, which occurred whilst the dust monitor was out for calibration. The webserver has been collected from site and an update will be provided in due course.

Location 2 (meter ref. TNO4778)

- 3.3 There was 0% data coverage during the monitoring period. The dust monitor at this location was removed for calibration on Friday 13th February 2026 and has since been returned to site.

Location 3 (meter ref. TNO4729)

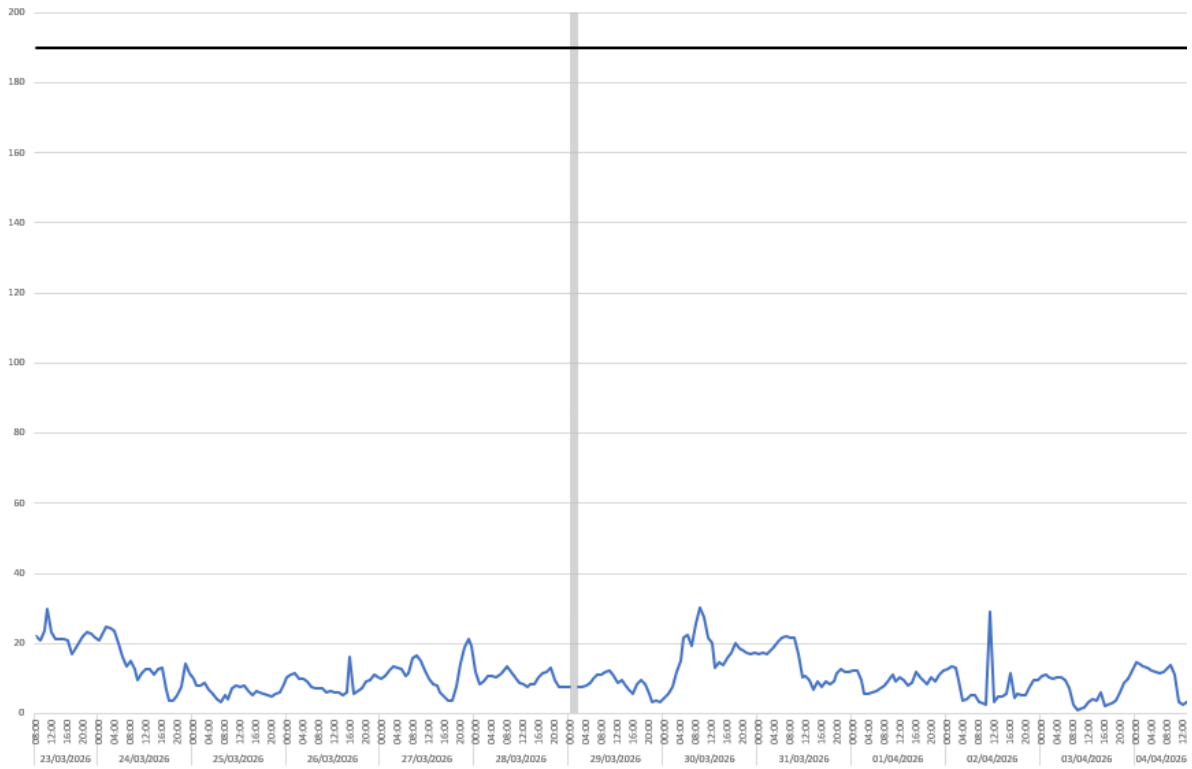

- Dust trigger level, 190 $\mu\text{g m}^{-3}$ 60-minute mean for PM10 concentrations
- Dust level, $\mu\text{g m}^{-3}$ 60-minute mean for PM10 concentrations
- Data unavailable

3.4 There was 100% data coverage of construction hours during the monitoring period. There were no exceedances of the dust trigger level of 190 $\mu\text{g m}^{-3}$ recorded at this location during construction hours. A shaded area showing unavailable data is shown on the above graph; however, this occurred on Sunday 29th March, outside of construction hours.




Noise Monitoring Results

Location 1 (meter ref. SMENK-9E5DF)

# Broadband Results					
Date	Time	LAeq(60min)	LAeq(7hr)	LAeq(10hr)	LAeq(5hr)
[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]	[dB]
2026-03-23	09:00:00	68.1	--	--	--
2026-03-23	10:00:00	68.2	--	--	--
2026-03-23	11:00:00	68.0	--	--	--
2026-03-23	12:00:00	68.4	--	--	--
2026-03-23	13:00:00	63.7	--	--	--
2026-03-23	14:00:00	65.7	--	--	--
2026-03-23	15:00:00	69.5	--	--	--
2026-03-23	16:00:00	65.1	--	--	--
2026-03-23	17:00:00	64.8	--	--	--
2026-03-23	18:00:00	62.1	--	66.9	--
2026-03-24	09:00:00	65.7	--	--	--
2026-03-24	10:00:00	65.3	--	--	--
2026-03-24	11:00:00	67.8	--	--	--
2026-03-24	12:00:00	68.3	--	--	--
2026-03-24	13:00:00	66.0	--	--	--
2026-03-24	14:00:00	64.9	--	--	--
2026-03-24	15:00:00	67.5	--	--	--
2026-03-24	16:00:00	67.0	--	--	--
2026-03-24	17:00:00	64.1	--	--	--
2026-03-24	18:00:00	63.1	--	66.3	--
2026-03-25	09:00:00	68.6	--	--	--
2026-03-25	10:00:00	68.3	--	--	--
2026-03-25	11:00:00	69.9	--	--	--
2026-03-25	12:00:00	69.6	--	--	--
2026-03-25	13:00:00	67.2	--	--	--
2026-03-25	14:00:00	66.0	--	--	--
2026-03-25	15:00:00	66.2	--	--	--
2026-03-25	16:00:00	68.9	--	--	--
2026-03-25	17:00:00	65.7	--	--	--
2026-03-25	18:00:00	62.6	--	67.7	--
2026-03-26	09:00:00	65.0	--	--	--
2026-03-26	10:00:00	65.7	--	--	--
2026-03-26	11:00:00	67.1	--	--	--
2026-03-26	12:00:00	65.1	--	--	--
2026-03-26	13:00:00	63.5	--	--	--
2026-03-26	14:00:00	64.4	--	--	--
2026-03-26	15:00:00	65.3	--	--	--
2026-03-26	16:00:00	64.1	--	--	--
2026-03-26	17:00:00	64.4	--	--	--
2026-03-26	18:00:00	62.2	--	64.9	--
2026-03-27	09:00:00	65.2	--	--	--
2026-03-27	10:00:00	64.4	--	--	--
2026-03-27	11:00:00	63.0	--	--	--
2026-03-27	12:00:00	64.3	--	--	--
2026-03-27	13:00:00	62.2	--	--	--
2026-03-27	14:00:00	64.1	--	--	--
2026-03-27	15:00:00	65.2	--	--	--
2026-03-27	16:00:00	64.4	--	--	--
2026-03-27	17:00:00	64.0	--	--	--
2026-03-27	18:00:00	64.5	--	64.2	--
2026-03-28	09:00:00	62.5	--	--	--
2026-03-28	10:00:00	61.3	--	--	--
2026-03-28	11:00:00	64.2	--	--	--
2026-03-28	12:00:00	61.0	--	--	--
2026-03-28	13:00:00	61.7	--	--	62.3
2026-03-29	18:00:00	--	--	61.9	--
2026-03-30	09:00:00	65.3	--	--	--
2026-03-30	10:00:00	65.1	--	--	--
2026-03-30	11:00:00	64.0	--	--	--
2026-03-30	12:00:00	65.0	--	--	--
2026-03-30	13:00:00	63.7	--	--	--
2026-03-30	14:00:00	64.2	--	--	--
2026-03-30	15:00:00	66.2	--	--	--
2026-03-30	16:00:00	67.4	--	--	--
2026-03-30	17:00:00	62.6	--	--	--
2026-03-30	18:00:00	62.7	--	64.8	--
2026-03-31	09:00:00	65.6	--	--	--
2026-03-31	10:00:00	66.8	--	--	--
2026-03-31	11:00:00	66.4	--	--	--
2026-03-31	12:00:00	67.1	--	--	--
2026-03-31	13:00:00	67.4	--	--	--
2026-03-31	14:00:00	65.2	--	--	--
2026-03-31	15:00:00	66.6	--	--	--
2026-03-31	16:00:00	65.2	--	--	--
2026-03-31	17:00:00	63.1	--	--	--
2026-03-31	18:00:00	66.3	--	66.1	--
2026-04-01	09:00:00	64.6	--	--	--
2026-04-01	10:00:00	66.2	--	--	--
2026-04-01	11:00:00	64.7	--	--	--
2026-04-01	12:00:00	65.3	--	--	--
2026-04-01	13:00:00	63.6	--	--	--
2026-04-01	14:00:00	63.6	--	--	--
2026-04-01	15:00:00	65.5	--	--	--
2026-04-01	16:00:00	64.2	--	--	--
2026-04-01	17:00:00	67.2	--	--	--
2026-04-01	18:00:00	62.9	--	65.0	--
2026-04-02	09:00:00	65.0	--	--	--
2026-04-02	10:00:00	65.1	--	--	--
2026-04-02	11:00:00	63.9	--	--	--
2026-04-02	12:00:00	64.3	--	--	--
2026-04-02	13:00:00	66.3	--	--	--
2026-04-02	14:00:00	67.1	--	--	--
2026-04-02	15:00:00	64.6	--	--	--
2026-04-02	16:00:00	63.5	--	--	--
2026-04-02	17:00:00	63.6	--	--	--
2026-04-02	18:00:00	66.1	--	65.1	--
2026-04-03	09:00:00	61.8	--	--	--
2026-04-03	10:00:00	60.4	--	--	--
2026-04-03	11:00:00	60.4	--	--	--
2026-04-03	12:00:00	61.2	--	--	--
2026-04-03	13:00:00	60.3	--	--	--
2026-04-03	14:00:00	60.7	--	--	--
2026-04-03	15:00:00	60.7	--	--	--
2026-04-03	16:00:00	61.7	--	--	--
2026-04-03	17:00:00	60.9	--	--	--
2026-04-03	18:00:00	63.3	--	61.2	--
2026-04-04	09:00:00	60.3	--	--	--
2026-04-04	10:00:00	59.4	--	--	--
2026-04-04	11:00:00	60.0	--	--	--
2026-04-04	12:00:00	62.8	--	--	--
2026-04-04	13:00:00	61.0	--	--	60.9

Location 1 (meter ref. SMENK-9E5DF) – Time History Data

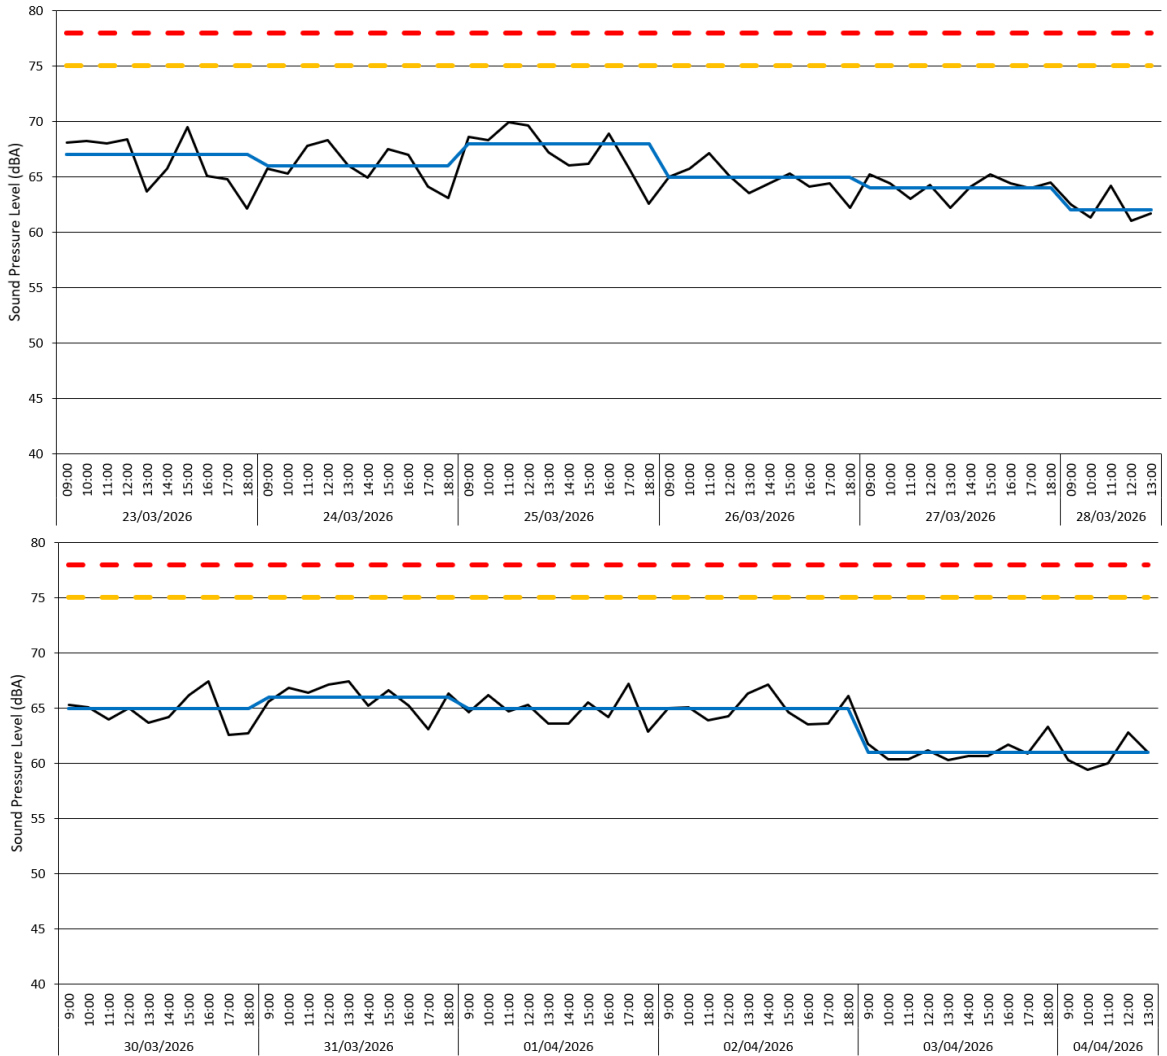


- Daily noise trigger level (75 dB LAeq,0800-1800 hours, LAeq,0800-1300 hours)
- - - Hourly noise action level (78 dB LAeq, 1 hour)
- Noise level, LAeq, 1 hour
- Daily noise level (dB LAeq,0800-1800 hours, LAeq,0800-1300 hours)
- Data unavailable

3.5 There was 100% data coverage at Location 1 during construction hours for the monitoring period. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) or hourly noise action level (78 dB LAeq,1 hour) at this location for the monitoring period covered by this report.

Location 2 (meter ref. VFHMP-7XSY7)

# Broadband Results				
Date	Time	LAeq(60min)	LAeq(10hr)	LAeq(5hr)
[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]
2026-03-23	09:00:00	69.8	--	--
2026-03-23	10:00:00	76.2	--	--
2026-03-23	11:00:00	74.9	--	--
2026-03-23	12:00:00	68.7	--	--
2026-03-23	13:00:00	63.8	--	--
2026-03-23	14:00:00	71.6	--	--
2026-03-23	15:00:00	66.2	--	--
2026-03-23	16:00:00	74.7	--	--
2026-03-23	17:00:00	68.7	--	--
2026-03-23	18:00:00	51.4	71.7	--
2026-03-24	09:00:00	64.4	--	--
2026-03-24	10:00:00	61.6	--	--
2026-03-24	11:00:00	76.4	--	--
2026-03-24	12:00:00	75.0	--	--
2026-03-24	13:00:00	57.5	--	--
2026-03-24	14:00:00	71.8	--	--
2026-03-24	15:00:00	70.6	--	--
2026-03-24	16:00:00	62.9	--	--
2026-03-24	17:00:00	57.7	--	--
2026-03-24	18:00:00	55.0	70.4	--
2026-03-25	09:00:00	67.3	--	--
2026-03-25	10:00:00	69.3	--	--
2026-03-25	11:00:00	75.8	--	--
2026-03-25	12:00:00	75.4	--	--
2026-03-25	13:00:00	57.0	--	--
2026-03-25	14:00:00	74.8	--	--
2026-03-25	15:00:00	68.8	--	--
2026-03-25	16:00:00	62.6	--	--
2026-03-25	17:00:00	58.5	--	--
2026-03-25	18:00:00	52.1	71.0	--
2026-03-26	09:00:00	61.7	--	--
2026-03-26	10:00:00	64.4	--	--
2026-03-26	11:00:00	63.2	--	--
2026-03-26	12:00:00	62.8	--	--
2026-03-26	13:00:00	60.1	--	--
2026-03-26	14:00:00	60.6	--	--
2026-03-26	15:00:00	62.6	--	--
2026-03-26	16:00:00	61.3	--	--
2026-03-26	17:00:00	57.1	--	--
2026-03-26	18:00:00	49.9	61.5	--
2026-03-27	09:00:00	65.8	--	--
2026-03-27	10:00:00	66.1	--	--
2026-03-27	11:00:00	63.4	--	--
2026-03-27	12:00:00	65.8	--	--
2026-03-27	13:00:00	59.9	--	--
2026-03-27	14:00:00	62.1	--	--
2026-03-27	15:00:00	64.8	--	--
2026-03-27	16:00:00	60.9	--	--
2026-03-27	17:00:00	56.4	--	--
2026-03-27	18:00:00	47.7	63.2	--
2026-03-28	09:00:00	61.0	--	--
2026-03-28	10:00:00	58.6	--	--
2026-03-28	11:00:00	59.5	--	--
2026-03-28	12:00:00	57.5	--	--
2026-03-28	13:00:00	55.2	--	58.8
2026-03-29	09:00:00	--	46.9	--
2026-03-30	09:00:00	67.1	--	--
2026-03-30	10:00:00	66.4	--	--
2026-03-30	11:00:00	63.7	--	--
2026-03-30	12:00:00	67.5	--	--
2026-03-30	13:00:00	63.7	--	--
2026-03-30	14:00:00	62.6	--	--
2026-03-30	15:00:00	66.3	--	--
2026-03-30	16:00:00	68.7	--	--
2026-03-30	17:00:00	56.8	--	--
2026-03-30	18:00:00	53.9	65.3	--
2026-03-31	09:00:00	72.1	--	--
2026-03-31	10:00:00	71.9	--	--
2026-03-31	11:00:00	70.0	--	--
2026-03-31	12:00:00	71.4	--	--
2026-03-31	13:00:00	62.7	--	--
2026-03-31	14:00:00	66.0	--	--
2026-03-31	15:00:00	69.5	--	--
2026-03-31	16:00:00	66.4	--	--
2026-03-31	17:00:00	62.6	--	--
2026-03-31	18:00:00	49.8	68.8	--
2026-04-01	09:00:00	62.4	--	--
2026-04-01	10:00:00	65.7	--	--
2026-04-01	11:00:00	63.7	--	--
2026-04-01	12:00:00	66.4	--	--
2026-04-01	13:00:00	60.9	--	--
2026-04-01	14:00:00	62.7	--	--
2026-04-01	15:00:00	65.9	--	--
2026-04-01	16:00:00	59.9	--	--
2026-04-01	17:00:00	58.7	--	--
2026-04-01	18:00:00	50.7	63.2	--
2026-04-02	09:00:00	66.7	--	--
2026-04-02	10:00:00	64.5	--	--
2026-04-02	11:00:00	68.7	--	--
2026-04-02	12:00:00	68.2	--	--
2026-04-02	13:00:00	55.0	--	--
2026-04-02	14:00:00	61.0	--	--
2026-04-02	15:00:00	57.5	--	--
2026-04-02	16:00:00	55.3	--	--
2026-04-02	17:00:00	55.6	--	--
2026-04-02	18:00:00	46.0	63.9	--
2026-04-03	09:00:00	44.4	--	--
2026-04-03	10:00:00	45.4	--	--
2026-04-03	11:00:00	46.6	--	--
2026-04-03	12:00:00	47.3	--	--
2026-04-03	13:00:00	43.8	--	--
2026-04-03	14:00:00	44.1	--	--
2026-04-03	15:00:00	44.6	--	--
2026-04-03	16:00:00	46.1	--	--
2026-04-03	17:00:00	45.6	--	--
2026-04-03	18:00:00	45.2	45.4	--
2026-04-04	09:00:00	43.0	--	--
2026-04-04	10:00:00	43.0	--	--
2026-04-04	11:00:00	43.6	--	--
2026-04-04	12:00:00	42.7	--	--
2026-04-04	13:00:00	44.0	--	43.3

Location 2 (meter ref. VFHMP-7XSY7) – Time History Data

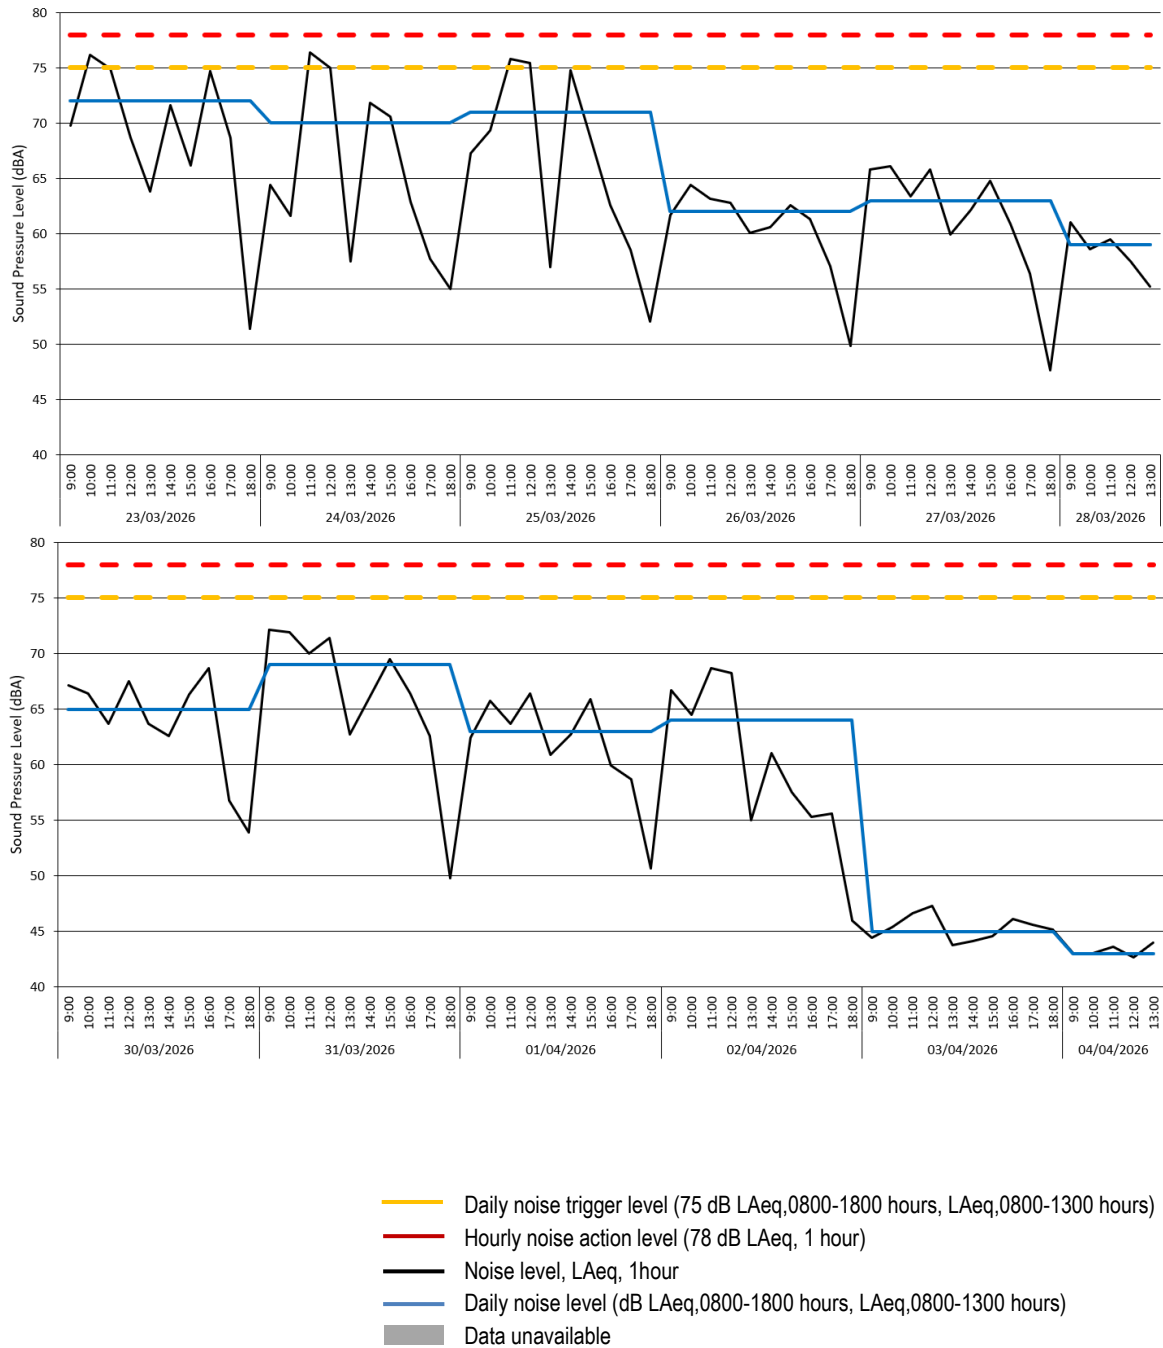


3.6 There was 100% data coverage at Location 2 during construction hours for the monitoring period covered by this report. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) or hourly noise action level (78 dB LAeq,1 hour) at this location for the monitoring period covered by this report.

Location 3 (meter ref. P5DLY-N3J7A) – Raw Data

# Broadband Results				
Date	Time	LAeq(60min)	LAeq(10hr)	LAeq(5hr)
[YYYY-MM-DD]	[hh:mm:ss]	[dB]	[dB]	[dB]
2026-03-23	09:00:00	55.8	--	--
2026-03-23	10:00:00	55.6	--	--
2026-03-23	11:00:00	55.6	--	--
2026-03-23	12:00:00	55.4	--	--
2026-03-23	13:00:00	52.6	--	--
2026-03-23	14:00:00	54.5	--	--
2026-03-23	15:00:00	56.5	--	--
2026-03-23	16:00:00	54.1	--	--
2026-03-23	17:00:00	53.1	--	--
2026-03-23	18:00:00	49.4	54.7	--
2026-03-24	09:00:00	56.0	--	--
2026-03-24	10:00:00	56.6	--	--
2026-03-24	11:00:00	56.5	--	--
2026-03-24	12:00:00	56.2	--	--
2026-03-24	13:00:00	57.3	--	--
2026-03-24	14:00:00	57.2	--	--
2026-03-24	15:00:00	56.1	--	--
2026-03-24	16:00:00	57.1	--	--
2026-03-24	17:00:00	53.6	--	--
2026-03-24	18:00:00	53.9	56.2	--
2026-03-25	09:00:00	55.5	--	--
2026-03-25	10:00:00	55.3	--	--
2026-03-25	11:00:00	56.8	--	--
2026-03-25	12:00:00	57.5	--	--
2026-03-25	13:00:00	52.8	--	--
2026-03-25	14:00:00	54.9	--	--
2026-03-25	15:00:00	55.6	--	--
2026-03-25	16:00:00	54.6	--	--
2026-03-25	17:00:00	53.2	--	--
2026-03-25	18:00:00	49.0	55.0	--
2026-03-26	09:00:00	54.6	--	--
2026-03-26	10:00:00	54.5	--	--
2026-03-26	11:00:00	60.0	--	--
2026-03-26	12:00:00	58.6	--	--
2026-03-26	13:00:00	60.9	--	--
2026-03-26	14:00:00	60.5	--	--
2026-03-26	15:00:00	55.3	--	--
2026-03-26	16:00:00	53.2	--	--
2026-03-26	17:00:00	55.4	--	--
2026-03-26	18:00:00	46.3	57.5	--
2026-03-27	09:00:00	57.3	--	--
2026-03-27	10:00:00	57.6	--	--
2026-03-27	11:00:00	57.9	--	--
2026-03-27	12:00:00	66.6	--	--
2026-03-27	13:00:00	56.3	--	--
2026-03-27	14:00:00	56.0	--	--
2026-03-27	15:00:00	58.0	--	--
2026-03-27	16:00:00	54.0	--	--
2026-03-27	17:00:00	55.5	--	--
2026-03-27	18:00:00	50.0	59.3	--
2026-03-28	09:00:00	52.9	--	--
2026-03-28	10:00:00	52.7	--	--
2026-03-28	11:00:00	51.5	--	--
2026-03-28	12:00:00	53.1	--	--
2026-03-28	13:00:00	55.2	--	53.3
2026-03-29	18:00:00	--	48.1	--
2026-03-30	09:00:00	58.2	--	--
2026-03-30	10:00:00	56.5	--	--
2026-03-30	11:00:00	54.9	--	--
2026-03-30	12:00:00	55.1	--	--
2026-03-30	13:00:00	55.5	--	--
2026-03-30	14:00:00	54.5	--	--
2026-03-30	15:00:00	55.3	--	--
2026-03-30	16:00:00	58.4	--	--
2026-03-30	17:00:00	57.0	--	--
2026-03-30	18:00:00	46.9	56.0	--
2026-03-31	09:00:00	57.3	--	--
2026-03-31	10:00:00	57.8	--	--
2026-03-31	11:00:00	59.8	--	--
2026-03-31	12:00:00	56.9	--	--
2026-03-31	13:00:00	56.7	--	--
2026-03-31	14:00:00	59.2	--	--
2026-03-31	15:00:00	56.9	--	--
2026-03-31	16:00:00	57.9	--	--
2026-03-31	17:00:00	56.8	--	--
2026-03-31	18:00:00	49.8	57.5	--
2026-04-01	09:00:00	55.3	--	--
2026-04-01	10:00:00	55.0	--	--
2026-04-01	11:00:00	54.6	--	--
2026-04-01	12:00:00	56.2	--	--
2026-04-01	13:00:00	60.1	--	--
2026-04-01	14:00:00	54.4	--	--
2026-04-01	15:00:00	55.4	--	--
2026-04-01	16:00:00	52.3	--	--
2026-04-01	17:00:00	59.8	--	--
2026-04-01	18:00:00	48.2	56.2	--
2026-04-02	09:00:00	56.4	--	--
2026-04-02	10:00:00	56.0	--	--
2026-04-02	11:00:00	56.7	--	--
2026-04-02	12:00:00	61.6	--	--
2026-04-02	13:00:00	51.3	--	--
2026-04-02	14:00:00	57.5	--	--
2026-04-02	15:00:00	52.5	--	--
2026-04-02	16:00:00	52.5	--	--
2026-04-02	17:00:00	62.4	--	--
2026-04-02	18:00:00	47.6	57.5	--
2026-04-03	09:00:00	46.4	--	--
2026-04-03	10:00:00	51.7	--	--
2026-04-03	11:00:00	48.6	--	--
2026-04-03	12:00:00	49.8	--	--
2026-04-03	13:00:00	46.5	--	--
2026-04-03	14:00:00	45.9	--	--
2026-04-03	15:00:00	48.4	--	--
2026-04-03	16:00:00	47.7	--	--
2026-04-03	17:00:00	46.8	--	--
2026-04-03	18:00:00	52.5	49.0	--
2026-04-04	09:00:00	45.8	--	--
2026-04-04	10:00:00	45.4	--	--
2026-04-04	11:00:00	46.2	--	--
2026-04-04	12:00:00	47.0	--	--
2026-04-04	13:00:00	46.2	--	46.1

Location 3 (meter ref. P5DLY-N3J7A) – Time History Data

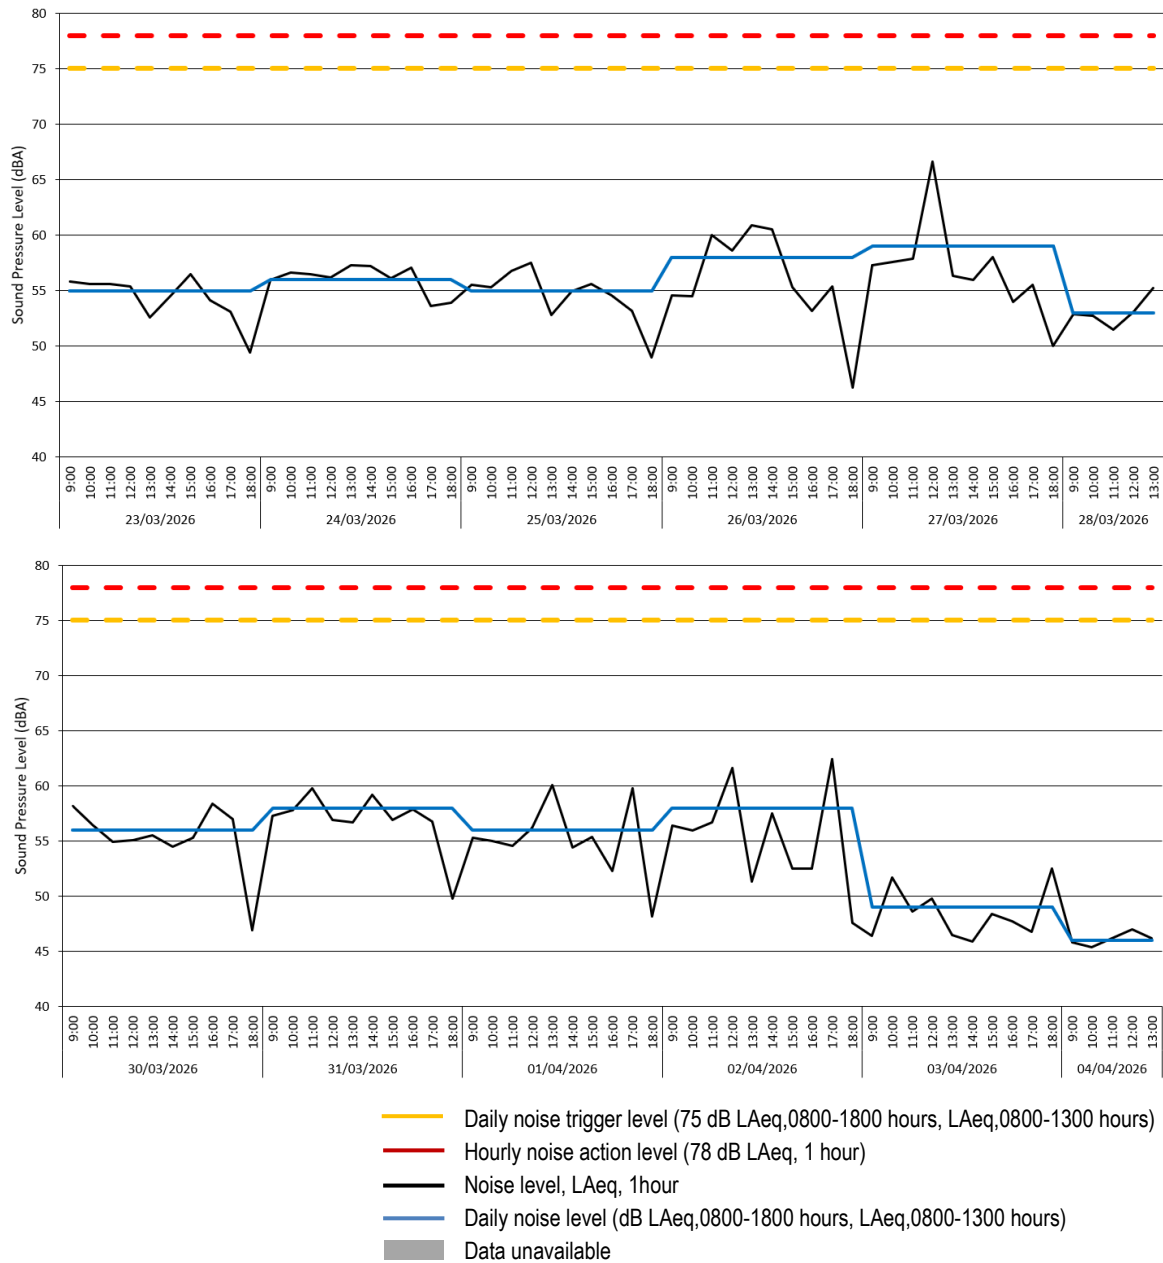

3.7 There was 100% data coverage during the monitoring period. There were no exceedances of the daily noise trigger level (75 dB LAeq,T) or hourly noise action level (78 dB LAeq,1 hour) at this location for the monitoring period covered by this report.

Vibration Monitoring Results


Location 1 (meter ref. PIJIVI) – Raw data

Order	Value	Date	Time
1	0.99	31/03/2026	08:43
2	0.98	30/03/2026	14:27
3	0.76	28/03/2026	12:29
4	0.72	23/03/2026	14:36
5	0.68	28/03/2026	10:59
6	0.53	28/03/2026	12:32
7	0.40	23/03/2026	15:15
8	0.37	02/04/2026	10:50
9	0.35	28/03/2026	11:49
10	0.25	01/04/2026	13:59

Measuring point: Holloway - L1
 Period: 2026-03-23_000000.000- - 18:00:00

Criteria mm/s PPV Exceedances
 1.0 0

Location 1 (meter ref. PIJIVI) – Time history graph

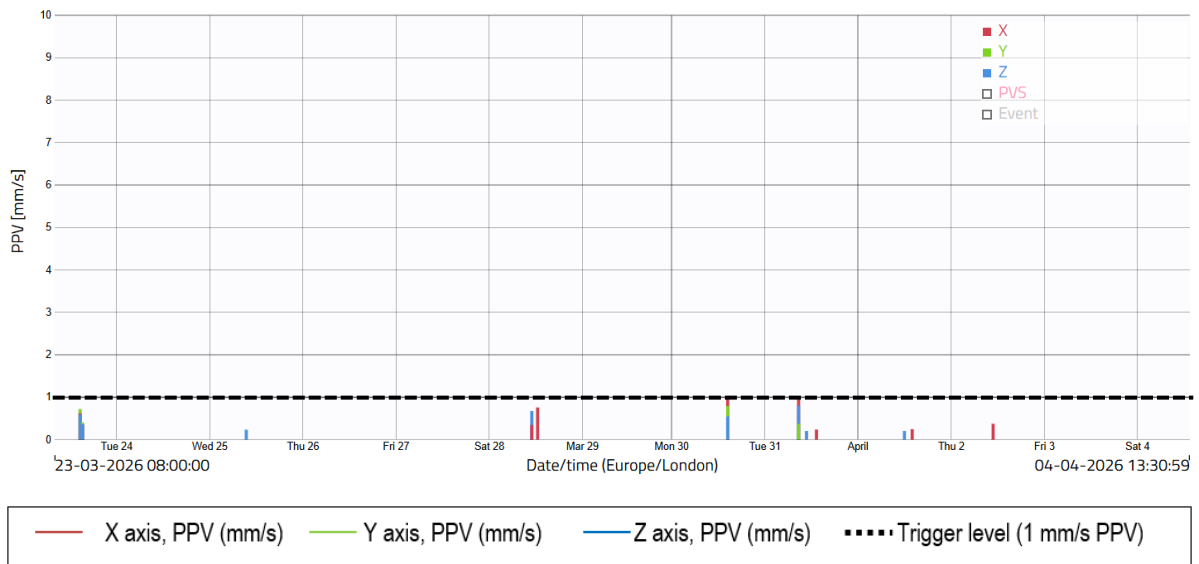

3.8 There was 100% data coverage at Location 1 during construction hours for the monitoring period covered by this report. There were no exceedances of the 1 mm/s vibration limit at Location 1 during the monitoring period covered by this report.


Location 2 (meter ref. LEQUMO) – Raw data

Order	Value	Date	Time
1	1.33	01/04/2026	12:46
2	0.77	30/03/2026	15:20
3	0.54	31/03/2026	12:02
4	0.49	01/04/2026	12:47
5	0.41	31/03/2026	09:08
6	0.38	01/04/2026	11:30
7	0.37	02/04/2026	08:19
8	0.35	31/03/2026	12:01
9	0.34	31/03/2026	11:13
10	0.34	02/04/2026	08:26

Measuring point: **Holloway - L2**
 Period: **2026-03-23_000000.000- - 18**

Criteria mm/s PPV Exceedances
1.0 **1**

Location 2 (meter ref. LEQUMO) – Time-history graph

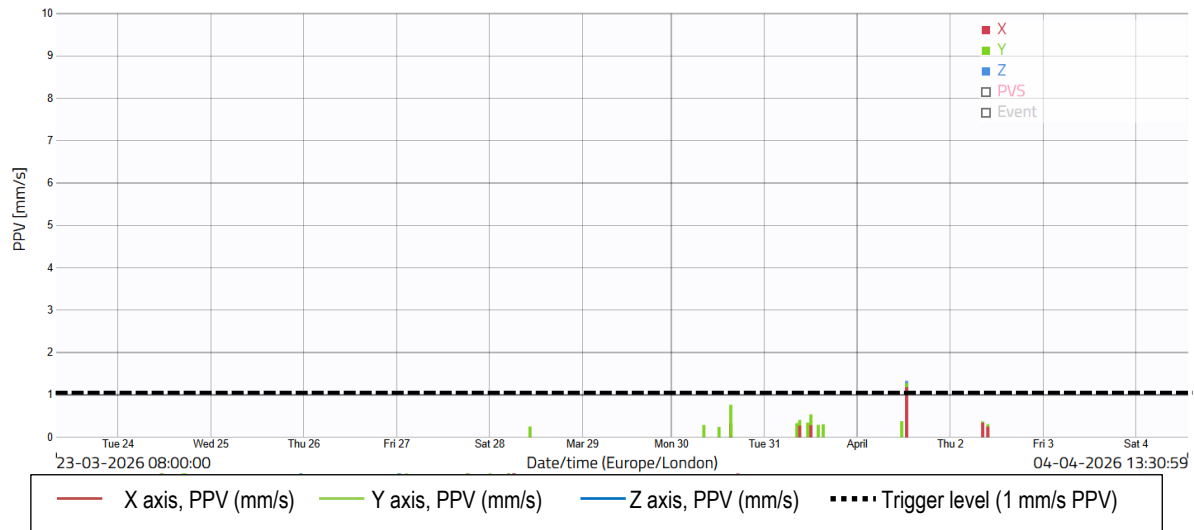

3.9 There was 100% data coverage at Location 2 during construction hours for the monitoring period covered by this report. There was one exceedance of the project vibration trigger level of 1.0 mm/s PPV. The highest recorded level occurred on Wednesday 1st April at 12:46, with a recorded level of 1.33 mm/s PPV. Based on discussions with site management, the exceedances are understood to have been caused by scaffolding and Metsec works across Block E.


Location 3 (meter ref. RIYORU) – Raw data

Measuring point: Period:
 Holloway - L3 2026-03-23_000000.000- - 18

Criteria mm/s PPV Exceedances
 4.0 0

Order	Value	Date	Time
1	0.79	27/03/2026	11:19
2	0.65	27/03/2026	11:13
3	0.64	02/04/2026	15:44
4	0.62	03/04/2026	17:18
5	0.55	27/03/2026	11:14
6	0.53	27/03/2026	11:25
7	0.47	27/03/2026	11:22
8	0.46	27/03/2026	11:16
9	0.43	27/03/2026	11:17
10	0.43	27/03/2026	11:26

Location 3 (meter ref. RIYORU) – Time-history graph

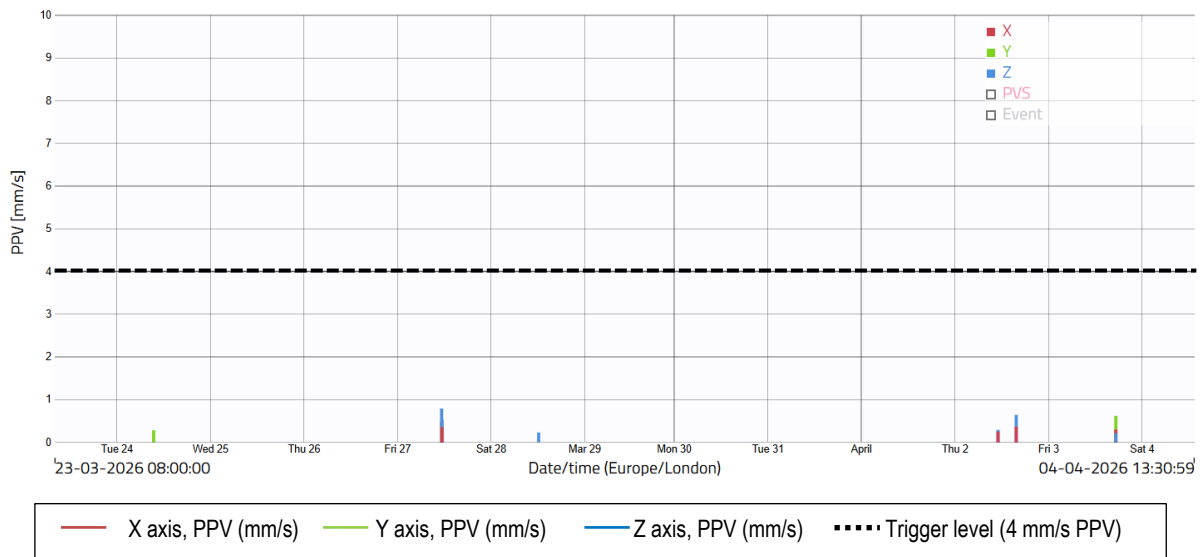

3.10 There was 100% data coverage at Location 3 during construction hours for the monitoring period covered by this report. There were no exceedances of the 4 mm/s vibration limit at this location during the monitoring period covered by this report. It is positive that no other exceedances were recorded at this location during the monitoring period.

Location 4 (meter ref. TEJELU)

3.11 There was 0% data coverage at Location 4 during construction hours for the monitoring period covered by this report. This was due to a flat battery and has since been replaced and the monitor is running as normal.